

EUROPEAN STANDARD

EN 81-1

NORME EUROPÉENNE

EUROPÄISCHE NORM

ICS 91.140.90

Descriptors : lifts, goods lifts, definitions, building codes, installation, safety requirements, lift cars, landing doors, lift wells, compensating ropes, shock absorbers, machine rooms, electrical installations, safety devices, stopping devices, locking devices, name plate, instructions, maintenance, conformity tests, certification.

English version

**Safety rules for the construction and installation of lifts -
Part 1 : Electric lifts**

Règles de sécurité pour la construction et
l'installation des ascenseurs -
Partie 1 : Ascenseurs électriques

Sicherheitsregeln für die Konstruktion und den
Einbau von Aufzügen -
Teil 1 : Elektrisch betriebene Personen-und
Lastenaufzüge

This European Standard was approved by CEN on (année-mois-jour).

CEN members are bound to comply with the CEN/CENELEC internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standard bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

CEN

European Committee for Standardization
Comité Européen de Normalisation
Europäisches Komitee für Normung

Central Secretariat : rue de Stassart 36, B-1050 Brussels

© 1998 Copyright reserved to all CEN members.

Ref. No. EN 81-1:1998 E

Contents

Foreword	6
0 Introduction	7
0.1 General	7
0.2 Principles	8
0.3 Assumptions	9
1 Scope	11
2 Normative references	12
3 Definitions	14
4 Units and symbols	17
4.1 Units.....	17
4.2 Symbols	17
5 Lift well	17
5.1 General provisions	17
5.2 Well enclosure	17
5.3 Walls, floor and ceiling of the well	21
5.4 Construction of the walls of lift wells and landing doors facing a car entrance	23
5.5 Protection of any spaces located below the car, the counterweight or the balancing weight	24
5.6 Protection in the well.....	24
5.7 Headroom and pit	24
5.8 Exclusive use of the lift well.....	27
5.9 Lighting of the well	27
5.10 Emergency release	28
6 Machine and pulley rooms	28
6.1 General provisions	28
6.2 Access	29
6.3 Construction and equipment of machine rooms	29
6.4 Construction and equipment of pulley rooms	31
7 Landing doors	33
7.1 General provisions	33
7.2 Strength of doors and their frames.....	33
7.3 Height and width of entrances.....	35
7.4 Sills, guides, door suspension	35
7.5 Protection in relation to door operation.....	36
7.6 Local lighting and “car here” signal lights	38
7.7 Locking and closed landing door check.....	39
7.8 Closing of automatically operated doors	42
8 Car, counterweight and balancing weight	42
8.1 Height of car	42
8.2 Available car area, rated load, number of passengers	42
8.3 Walls, floor and roof of the car	44
8.4 Apron	45
8.5 Car entrance	46
8.6 Car doors	46
8.7 Protection during operation of doors	47
8.8 Reversal of closing movement	49
8.9 Electrical device for proving the car doors closed	49

8.10	Sliding doors with multiple, mechanically linked panels	49
8.11	Opening the car door	50
8.12	Emergency trap doors and emergency doors.....	50
8.13	Car roof.....	51
8.14	Car header	52
8.15	Equipment on top of the car	52
8.16	Ventilation	53
8.17	Lighting	53
8.18	Counterweight and balancing weight.....	53
9	Suspension, compensation and overspeed protection	54
9.1	Suspension	54
9.2	Sheave, pulley, drum and rope diameter ratios, rope/chain terminations	54
9.3	Rope traction.....	55
9.4	Winding up of ropes for positive drive lifts	55
9.5	Distribution of load between the ropes or the chains	56
9.6	Compensation with ropes	56
9.7	Protection for traction sheaves, pulleys and sprockets.....	57
9.8	Safety gear	58
9.9	Overspeed governor	60
9.10	Ascending car overspeed protection means.....	62
10	Guide rails, buffers and final limit switches	64
10.1	General provisions concerning guide rails.....	64
10.2	Guiding of the car, counterweight or balancing weight	65
10.3	Car and counterweight buffers	66
10.4	Stroke of car and counterweight buffers.....	66
10.5	Final limit switches	68
11	Clearances between car and wall facing the car entrance, and between car, counterweight or balancing weight	69
11.1	General provision	69
11.2	Clearances between car and wall facing the car entrance.....	69
11.3	Clearances between car, counterweight or balancing weight	71
12	Lift machine.....	71
12.1	General provision	71
12.2	Drive of the car and the counterweight or balancing weight	71
12.3	Use of overhung pulleys or sprockets	71
12.4	Braking system	72
12.5	Emergency operation	73
12.6	Speed	73
12.7	Stopping the machine and checking its stopped condition	74
12.8	Monitoring the normal slowdown of the machine in case of reduced buffer stroke	75
12.9	Safety devices against slack rope or slack chain	76
12.10	Motor run time limiter	76
12.11	Protection of machinery	77
13	Electric installations and appliances.....	77
13.1	General provisions	77
13.2	Contactors, relay-contactors, components of safety circuits.....	79
13.3	Protection of motors and other electrical equipment	80
13.4	Main switches.....	80
13.5	Electric wiring.....	81
13.6	Lighting and socket outlets.....	83
14	Protection against electric faults ; controls ; priorities	84

14.1	Failure analysis and electric safety devices	84
14.2	Controls	89
15	Notices, markings and operating instructions	95
15.1	General provisions	95
15.2	Car	95
15.3	Car roof.....	96
15.4	Machine and pulley rooms	96
15.5	Well.....	97
15.6	Overspeed governor	97
15.7	Pit	98
15.8	Buffers	98
15.9	Landing identification	98
15.10	Electrical identification.....	98
15.11	Unlocking key for landing doors	98
15.12	Alarm device	98
15.13	Locking devices	98
15.14	Safety gear	99
15.15	Groups of lifts.....	99
15.16	Ascending car overspeed protection means.....	99
16	Examinations - Tests - Register - Maintenance	99
16.1	Examinations and tests	99
16.2	Register	100
16.3	Installer information.....	101
Annex A (normative) List of the electric safety devices		103
Annex B (normative) Unlocking triangle.....		104
Annex C (informative) Technical dossier.....		105
C.1	Introduction	105
C.2	General	105
C.3	Technical details and plans	105
C.4	Electric schematic diagrams.....	106
C.5	Verification of conformity.....	106
Annex D (normative) Examinations and tests before putting into service.....		107
D.1	Examinations	107
D.2	Tests and verifications	107
Annex E (informative) Periodical examinations and tests, examinations and tests after an important modification or after an accident.....		111
E.1	Periodical examinations and tests	111
E.2	Examinations and tests after an important modification or after an accident.....	111
Annex F (normative) Safety components - Tests procedures for verification of conformity		113
F.0	Introduction	113
F.1	Landing door locking devices	115
F.2	Kept free	120
F.3	Safety gear	120
F.4	Overspeed governors.....	128
F.5	Buffers	130
F.6	Safety circuits containing electronic components	136
F.7	Ascending car overspeed protection means.....	139
Annex G (informative) Proof of guide rails		143
G.1	General	143

G.2	Loads and forces	143
G.4	Impact factors	145
G.5	Calculations	146
G.6	Permissible deflections	154
G.7	Examples of calculation method.....	154
Annex H (normative) Electronic components - Failure exclusion.....		177
Annex J (normative) Pendulum shock tests.....		185
J.1	General	185
J.2	Test rig.....	185
J.3	Panels.....	185
J.4	Test procedure.....	186
J.5	Interpretation of the results	186
J.6	Test report	186
J.7	Exceptions from the tests.....	187
Annex K (normative) Top clearances for traction drive lifts.....		191
Annex L (normative) Necessary buffer stroke.....		192
Annex M (informative) Traction evaluation.....		193
M.1	Introduction	193
M.2	Traction calculation	193
M.3	Practical example.....	199
Annex N (normative) Evaluation of safety factor for suspension ropes.....		203
N.1	General	203
N.2	Equivalent number N_{equiv} of pulleys	203
N.3	Safety factor.....	204
Annex ZA (informative) Clauses of this standard addressing essential requirements or other provisions of EU Directives.....		208

Foreword

This European Standard has been prepared by Technical Committee CEN/TC 10 " Passenger, goods and service lifts", the secretariat of which is held by AFNOR

This European Standard replaces EN 81-1:1985

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by February 1999, and conflicting national standards shall be withdrawn at the latest by February 1999.

This European Standard has been prepared under a mandate given to CEN by the European Commission and the European Free Trade Association, and supports essential requirements of EU Directive(s).

For relationship with EU Directive(s), see informative Annex ZA, which is an integral part of this standard.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

This is the third edition of the standard. It is an amendment of the edition 1985 and shall be given the status of a harmonised standard. The amendment is mainly based on the following points :

- elimination of national deviations ;
- incorporation of essential health and safety requirements from the relevant EU Directives ;
- elimination of obvious errors ;
- incorporation of proposals resulting from interpretation requests dealing with the improvement relative to the progress in technology ;
- improvement of the references to other standards according to the progress in that field.

After the CEN Enquiry on prEN81-1:1994 the EU Directive on Lifts (95/16/EC) was adopted. The requirements resulting from the essential health and safety requirements of this Directive being not taken into consideration in the draft have been summarised in the Addendum prA1:1996 to prEN81-1:1994 and submitted to the members of CEN/TC 10 for approval. Having received the approval this Addendum has been incorporated into this standard taking into account the comments received from TC members.

This standard does not correspond in all points to the present internal rules of CEN regarding the format of safety standards. However, the format of this standard has been accepted by the interested parties and is therefore regarded as the better way of implementation of the essential health and safety requirements than a formalistic re-draft. This mainly because of the coming into force of the EU Directive 95/16/EC on 97-07-01.

With the next revision of the standard, being already intended, this shortcomings will be removed.

0 Introduction

0.1 General

0.1.1 The object of this standard is to define safety rules related to passenger- and goods/passenger-lifts with a view to safeguarding persons and objects against the risk of accidents associated with the user-, maintenance- and emergency operation of lifts ¹⁾.

0.1.2 A study has been made of the various aspects of incidents possible with lifts in the following areas :

0.1.2.1 Risks possible due to :

- a) shearing ;
- b) crushing ;
- c) falling ;
- d) impact ;
- e) trapping ;
- f) fire ;
- g) electric shock ;
- h) failure of material due to :
 - 1) mechanical damage ;
 - 2) wear ;
 - 3) corrosion.

0.1.2.2 Persons to be safeguarded :

- a) users ;
- b) maintenance and inspection personnel ;
- c) persons outside the lift well, the machine room and pulley room (if any).

¹⁾ Within CEN/TC 10 an interpretation committee has been established to answer questions about the spirit in which the experts have drafted the various clauses of this standard. The issued interpretations are available from National Standards Bodies.

0.1.2.3 Objects to be safeguarded :

- a) loads in car ;
- b) components of the lift installation ;
- c) building in which the lift is installed.

0.2 Principles

In drawing up this standard the following have been used.

0.2.1 This standard does not repeat all the general technical rules applicable to every electrical, mechanical, or building construction including the protection of building elements against fire.

It has, however, seemed necessary to establish certain requirements of good construction, either because they are peculiar to lift manufacture or because in the case of lift utilization the requirements may be more stringent than elsewhere.

0.2.2 This standard does not only address the essential safety requirements of the Lift Directive, but additionally states minimum rules for the installation of lifts into buildings/constructions. There may be in some countries regulations for the construction of buildings etc. which cannot be ignored.

Typical clauses affected by this are those defining minimum values for the height of the machine and pulley rooms and for their access doors dimensions.

0.2.3 When the weight, size and/or shape of components prevent them from being moved by hand, they are :

- a) either fitted with attachments for lifting gear, or
- b) designed so that they can be fitted with such attachments (e.g. by means of threaded holes),
or
- c) shaped in such a way that standard lifting gear can easily be attached.

0.2.4 As far as possible the standard sets out only the requirements that materials and equipment have to meet in the interests of safe operation of lifts.

0.2.5 Negotiations have been made between the customer and the supplier about :

- a) the intended use of the lift ;
- b) environmental conditions ;
- c) civil engineering problems ;
- d) other aspects related to the place of installation.

0.3 Assumptions

Possible risks have been considered of each component that may be incorporated in a complete lift installation.

Rules have been drawn up accordingly.

0.3.1 Components are :

- a) designed in accordance with usual engineering practice and calculation codes, taking into account all failure modes ;
- b) of sound mechanical and electrical construction ;
- c) made of materials with adequate strength and of suitable quality ;
- d) be free of defects.

Harmful materials, such as asbestos are not used.

0.3.2 Components are kept in good repair and working order, so that the required dimensions remain fulfilled despite wear.

0.3.3 Components will be selected and installed so that foreseeable environmental influences and special working conditions do not affect the safe operation of the lift.

0.3.4 By design of the load bearing elements, a safe operation of the lift is assured for loads ranging from 0 % to 100 % of the rated load.

0.3.5 The requirements of this standard regarding electrical safety devices are such that the possibility of a failure of an electric safety device complying with all the requirements of the standard needs not to be taken into consideration.

0.3.6 Users have to be safeguarded against their own negligence and unwitting carelessness when using the lift in the intended way.

0.3.7 A user may, in certain cases, make one imprudent act. The possibility of two simultaneous acts of imprudence and/or the abuse of instructions for use is not considered.

0.3.8 If in the course of maintenance work a safety device, normally not accessible to the users, is deliberately neutralised, safe operation of the lift is no longer assured, but compensatory measures will be taken to ensure users safety in conformity with maintenance instructions.

It is assumed that maintenance personnel is instructed and works according to the instructions.

0.3.9 For horizontal forces, the following have been used :

- a) static force : 300 N ;
 - b) force resulting from impact : 1000 N ;
- reflecting the values that one person can exert.

0.3.10 With the exception of the items listed below, a mechanical device built according to good practice and the requirements of the standard will not deteriorate to a point of creating hazard without the possibility of detection.

The following mechanical failures are considered :

- a) breakage of the suspension ;
- b) uncontrolled slipping of the ropes on the traction sheave ;
- c) breakage and slackening of all linkage by auxiliary ropes, chains and belts ;
- d) failure of one of the mechanical components of the electromechanical brake which take part in the application of the braking action on the drum or disk ;
- e) failure of a component associated with the main drive elements and the traction sheave.

0.3.11 The possibility of the safety gear not setting, should the car free fall from the lowest landing, before the car strikes the buffer(s) is considered acceptable.

0.3.12 When the speed of the car is linked to the electrical frequency of the mains up to the moment of application of the mechanical brake, the speed is assumed not to exceed 115 % of the rated speed or a corresponding fractional speed.

0.3.13 The organisation within the building, where the lift is installed, is such that it can respond effectively to emergency calls without undue delay (see **0.2.5**).

0.3.14 Means of access are provided for the hoisting of heavy equipment (see **0.2.5**).

0.3.15 To ensure the correct functioning of the equipment in the machine room, i.e. taking into account the heat dissipated by the equipment, the ambient temperature in the machine room is assumed to be maintained between + 5 °C and + 40 °C.

1 Scope

1.1 This standard specifies the safety rules for the construction and installation of permanently installed new electric lifts, with traction or positive drive, serving defined landing levels, having a car designed for the transportation of persons or persons and goods, suspended by ropes or chains and moving between guide rails inclined not more than 15° to the vertical.

1.2 In addition to the requirements of this standard supplementary requirements shall be considered in special cases (potentially explosive atmosphere, extreme climate conditions, seismic conditions, transporting dangerous goods, etc.).

1.3 This standard does not cover :

- a) lifts with drives other than those stated in **1.1**;
- b) installation of electric lifts in existing buildings ²⁾ to the extent that space does not permit ;
- c) important modifications (see **annex E**) to a lift installed before this standard is brought into application ;
- d) lifting appliances, such as paternosters, mine lifts, theatrical lifts, appliances with automatic caging, skips, lifts and hoists for building and public works sites, ships' hoists, platforms for exploration or drilling at sea, construction and maintenance appliances ;
- e) installations where the inclination of the guide rails to the vertical exceeds 15° ;
- f) safety during transport, installation, repairs, and dismantling of lifts.

However, this standard may usefully be taken as a basis.

Noise and vibrations are not dealt with in this standard because these are not relevant to the safe use of the lift.

1.4 This standard does not specify the additional requirements necessary for the use of lifts in case of fire.

²⁾ Existing building is a building which is used or was already used before the order for the lift was placed. A building whose internal structure is completely renewed is considered as a new building.

2 Normative references

This European standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies.

CEN/CENELEC standards

EN 294	1992	Safety of machinery - Safety distances to prevent danger zones being reached by the upper limbs
EN 1050		Safety of machinery - Principles for risk assessment
EN 10025		Hot rolled products of non alloy structural steels -Technical delivery conditions
EN 50214		Flexible cables for lifts
EN 60068-2-6		Environmental testing - Part 2 : Tests - Test Fc : Vibration (sinusoidal)
EN 60068-2-27		Basic environmental testing procedures - Part 2 : Tests - Test Ea and guidance : Shock
EN 60068-2-29		Basic environmental testing procedures - Part 2 : Tests - Test Eb and guidance : Bump
EN 60249-2-2		Base materials for printed circuits - Part 2 : Specifications - Specification N°2 : Phenolic cellulose paper copper-clad laminated sheet, economic quality
EN 60249-2-3		Base materials for printed circuits - Part 2 : Specifications - Specification N°3 : Epoxyde cellule paper copper-clad laminated sheet of defined flammability (vertical burning test)
EN 60742		Isolating transformers and safety isolating transformers – Requirements
EN 60947-4-1		Low-voltage switchgear and controlgear - Part 4 : Contactors and motor-starters - Section 1 : Electromechanical contactors and motor-starters
EN 60947-5-1		Low-voltage switchgear and controlgear - Part 5 : Control circuit devices and switching elements - Section 1 : Electromechanical control circuit devices
EN 60950		Safety of information technology equipment, including electrical business equipment

EN 62326-1		Printed boards – Part 1 : Generic specification
EN 12015	1998	Electromagnetic compatibility - Product family standard for lifts, escalators and passenger conveyors – Emission
EN 12016	1998	Electromagnetic compatibility - Product family standard for lifts, escalators and passenger conveyors - Immunity
prEN 81-8	1997	Fire resistance tests of lift landing doors - Method of test and evaluation

IEC standards

IEC 60664-1		Insulation co-ordination for equipment within low-voltage systems - Part 1 : Principles, requirements and tests
IEC 60747-5		Semiconductor devices – Discrete devices and integrated circuits – Part 5 : Optoelectronic devices

CENELEC Harmonization Documents

HD 21.1 S3		Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V - Part 1: General requirements
HD 21.3 S3		Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V - Part 3 : Non-sheathed cables for fixed wiring
HD 21.4 S2		Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V – Part 4 : Sheathed cables for fixed wiring
HD 21.5 S3		Polyvinyl chloride insulated cables of rated voltages up to and including 450/750 V - Part 5 : Flexible cables (cords)
HD 22.4 S3		Rubber insulated cables of rated voltages up to and including 450/750 V - Part 4 : Cords and flexible cables
HD 214 S2		Method for determining the comparative and the proof tracking indices of solid insulating materials under moist conditions
HD 323.2.14 S2		Basic environmental testing procedures - Part 2 : Tests - Test N : Change of temperature
HD 360 S2		Circular rubber insulated lift cables for normal use
HD 384.4.41 S2		Electrical installations of buildings - Part 4 : Protection for safety - Chapter 41 : Protection against electric shock

HD 384.5.54 S1	Electrical installations of buildings - Part 5 : Selection and erection of electrical equipment - Chapter 54 : Earthing arrangements and protective conductors
HD 384.6.61 S1	Electrical installations of buildings - Part 6 : Verification - Chapter 61 : Initial verification

ISO Standards

ISO 7465	1997	Passenger lifts and service lifts – Guide rails for lifts and counterweights – T type
----------	------	---

3 Definitions

For the purposes of this standard, the following definitions apply :

apron (*garde-pieds*) (*Schürze*) : Smooth vertical part extending downwards from the sill of the landing or car entrance.

available car area (*surface utile de la cabine*) (*Nutzfläche des Fahrkorbes*) : Area of the car measured at a height of 1 m above floor level, disregarding handrails, which is available for passengers or goods during operation of the lift.

balancing weight (*masse d'équilibrage*) (*Ausgleichgewicht*) : Mass which saves energy by balancing all or part of the mass of the car.

buffer (*amortisseur*) (*Puffer*) : A resilient stop at the end of travel, and comprising a means of braking using fluids or springs (or other similar means).

car (*cabine*) (*Fahrkorb*) : A part of the lift which carries the passengers and/or other loads.

counterweight (*contrepoids*) (*Gegengewicht*) : Mass which ensures traction.

electric safety chain (*chaîne électrique des sécurités*) (*Elektrische Sicherheitskette*) : The total of the electric safety devices connected in series.

goods passenger lift (*ascenseur de charge*) ³⁾ (*Lastenaufzug*) : A lift mainly intended for the transport of goods, which are generally accompanied by persons.

³⁾ The French expression “ascenseur de charge” has been introduced into the French language document with the aim of harmonizing the texts in the three languages of CEN and of simplifying the wording. It does not in any way define a particular or supplementary category of lift.

guide rails (*guides*) (*Führungsschienen*). The rigid components which provide guiding for the car, the counterweight or the balancing weight.

headroom (*partie supérieure de la gaine*) (*Schachtkopf*) : Part of the well between the highest landing served by the car and the ceiling of the well.

instantaneous safety gear (*parachute à prise instantanée*) (*Sperrfangvorrichtung*) : A safety gear in which the full gripping action on the guide rails is almost immediate.

instantaneous safety gear with buffered effect (*parachute à prise instantanée avec effet amorti*) (*Sperrfangvorrichtung mit Dämpfung*) : A safety gear in which the full gripping action on the guide rails is almost immediate, but the reaction on the car, counterweight or balancing weight is limited by presence of an intermediate buffering system.

laminated glass (*verre feuilleté*) (*Verbundsicherheitsglas VSG*) : An assembly of 2 or more glass layers, each of which is bonded together using a plastic film.

levelling (*nivelage*) (*Einfahren*) : An operation which improves the accuracy of stopping at landings.

lift machine (*machine*) (*Triebwerk*) : The unit including the motor which drives and stops the lift.

machine room (*local de machines*) (*Triebwerksraum*) : A room in which machine or machines and/or the associated equipment are placed.

minimum breaking load of a rope (*charge de rupture minimale d'un câble*) (*Mindestbruchkraft eines Seiles*) : The product of the square of the nominal diameter of the rope (in square millimetres) and the nominal tensile strength of the wires (in newtons per square millimetre) and a coefficient appropriate to the type of rope construction.

overspeed governor (*limiteur de vitesse*) (*Geschwindigkeitsbegrenzer*) : A device which, when the lift attains a predetermined speed, causes the lift to stop, and if necessary causes the safety gear to be applied.

passenger (*passager*) (*Fahrgast*) : Any person transported by a lift in the car.

pit (*cuvette*) (*Schachtgrube*) : The part of the well situated below the lowest landing served by the car.

positive drive lift (includes drum drive) (*ascenseur à treuil attelé*) (*Trommelaufzug, Kettenaufzug*) : A lift suspended by chains or ropes driven by means other than friction.

progressive safety gear (*parachute à prise amortie*) (*Bremsfangvorrichtung*) : A safety gear in which retardation is effected by a braking action on the guide rails and for which special provisions are made so as to limit the forces on the car, counterweight or balancing weight to a permissible value.

pulley room (*local de poulies*) (*Rollenraum*) : A room not containing the machine, in which pulleys are located, and in which the overspeed governor and the electrical equipment can also be housed.

rated load (*charge nominale*) (*Nennlast*) : The load for which the equipment has been built.

rated speed (*vitesse nominale*) (*Nenngeschwindigkeit*) : The speed v in metres per second of the car for which the equipment has been built.

re-levelling (*isonivelage*) (*Nachstellen*) : An operation, after the lift has stopped, to permit the stopping position to be corrected during loading or unloading, if necessary by successive movements (automatic or inching).

safety gear (*parachute*) (*Fangvorrichtung*) : A mechanical device for stopping, and maintaining stationary on the guide rails, the lift car, counterweight or balancing weight in case of overspeeding or breaking of the suspension.

safety rope (*câble de sécurité*) (*Sicherheitsseil*) : An auxiliary rope attached to the car, the counterweight or balancing weight for the purpose of tripping a safety gear in case of suspension failure.

sling (*étrier*) (*Rahmen*) : The metal framework carrying the car, counterweight or balancing weight, connected to the means of suspension. This sling can be integral with the car enclosure.

traction drive lift (*ascenseur à adhérence*) (*Treibscheiben-Aufzug*) : A lift whose lifting ropes are driven by friction in the grooves of the driving sheave of the machine.

travelling cable (*câble pendentif*) (*Hängekabel*) : Flexible cable between the car and a fixed point.

unlocking zone (*zone de déverrouillage*) (*Entriegelungszone*) : A zone, extending above and below the stopping level, in which the car floor must be to enable the corresponding landing door to be unlocked.

user (*usager*) (*Benutzer*) : Person making use of the services of a lift installation.

well (*gaine*) (*Schacht*) : The space in which the car, the counterweight or the balancing weight travels. This space is usually bounded by the bottom of the pit, the walls and the ceiling of the well.

4 Units and symbols

4.1 Units

The units used are chosen from the International System of units (SI).

4.2 Symbols

Symbols are explained relevant to the formulae used.

5 Lift well

5.1 General provisions

5.1.1 The requirements of this clause relate to wells containing one or more lift cars.

5.1.2 The counterweight or the balancing weight of a lift shall be in the same well as the car.

5.2 Well enclosure

5.2.1 A lift shall be separated from the surroundings by :

- a) walls, floor and ceiling, or
- b) sufficient space.

5.2.1.1 Totally enclosed well

In sections of the building where the well is required to contribute against the spread of fire, the well shall be totally enclosed by imperforate walls, floor and ceiling.

The only permissible openings are :

- a) openings for landing doors ;
- b) openings for inspection and emergency doors to the well and inspection traps ;
- c) vent openings for escape of gases and smoke in the event of fire ;
- d) ventilation openings ;
- e) necessary openings for the functioning of the lift between the well and the machine or pulley rooms ;
- f) openings in partition between lifts according to **5.6**.

5.2.1.2 Partially enclosed well

Where the well is not required to contribute against the spread of fire, e.g. observation lifts in connection with galleries or atriums, tower buildings, etc., the well does not need to be totally enclosed, provided :

a) the height of the enclosure at places normally accessible to persons shall be sufficient to prevent such persons :

- being endangered by moving parts of the lift, and
- interfering with the safe operation of the lift by reaching lift equipment within the well either directly or with hand-held objects.

The height is assumed to be sufficient if it is in conformity with **figure 1** and **2**, that means :

- 1) minimum 3,50 m at a landing door side ;
- 2) minimum 2,50 m at other sides and with a minimum horizontal distance of 0,50 m to moving parts of the lift.

If the distance to moving parts exceeds 0,50 m, the value of 2,50 m can be reduced progressively to a minimum height of 1,10 m in a distance of 2,0 m ;


b) the enclosure shall be imperforate ;

c) the enclosure shall be located within 0,15 m maximum of the edges of floors, stairs or platforms (see **figure 1**) ;

d) provisions shall be taken to prevent the interference with the operation of the lift by other equipment (see **5.8 b**) and **16.3.1 c) f)**); (*corrigendum*)

e) special precautions shall be taken for lifts exposed to weather (see **0.3.3**), e.g. wall climbing lifts installed against the exterior walls of a building.

NOTE : Installation of lifts with partially enclosed well should only occur after full consideration of the environmental-/ location conditions.



- C car
- H height of the enclosure
- D distance to moving parts of the lift (see figure 2)

Figure 1 : Partially enclosed well




Figure 2 : Partially enclosed well - Distances

5.2.2 Inspection and emergency doors - Inspection traps

5.2.2.1 Inspection and emergency doors, and inspection traps to the well, shall not be used except on grounds of safety to users or the requirements of maintenance.

5.2.2.1.1 Inspection doors shall have a minimum height of 1,40 m and a minimum width of 0,60 m.

Emergency doors shall have a minimum height of 1,80 m and a minimum width of 0,35 m.

Inspection traps shall have a maximum height of 0,50 m and a maximum width of 0,50 m.

5.2.2.1.2 When the distance between consecutive landing doorsills exceeds 11 m, intermediate emergency doors shall be provided, such that the distance between sills is not more than 11 m. This requirement is not called for in the case of adjacent cars, each fitted with an emergency door provision for which is made in **8.12.3**.

5.2.2.2 Inspection and emergency doors and inspection traps shall not open towards the interior of the well.

5.2.2.2.1 The doors and traps shall be provided with a key-operated lock, capable of being reclosed and relocked without a key.

Inspection and emergency doors shall be capable of being opened from inside the well without a key even when locked.

5.2.2.2.2 Operation of the lift shall automatically depend on maintaining these doors and traps in the closed position. For this purpose electric safety devices in conformity with **14.1.2** shall be employed.

An electric safety device is not required in case of access door(s) to the pit (**5.7.3.2**) provided the door(s) does not give access to a hazardous zone. This is regarded to be the case if the free vertical distance between the lowest parts of car, counterweight or balancing weight including guide shoes, apron, etc. during normal operation and the bottom of the pit is at least 2 m.

The presence of travelling cables, compensating ropes/chains and their equipment, tensioning pulleys for the overspeed governor and similar installations is not regarded as being hazardous.

5.2.2.3 Inspection and emergency doors and inspection traps shall be imperforate, satisfy the same requirements for mechanical strength as the landing doors, and comply with the regulations relevant to the fire protection for the building concerned.

5.2.3 Ventilation of the well

The well shall be suitably ventilated. It shall not be used to provide ventilation of rooms other than those belonging to the lift.

NOTE : In the absence of relevant regulations or standards, it is recommended that ventilation openings at the top of the well, with a minimum area of 1 % of the horizontal section of the well, are provided.

5.3 Walls, floor and ceiling of the well

The structure of the well shall conform to National Building Regulations and be able to support at least the loads which may be applied by the machine, by the guide rails at the moment of safety gear operation, in the case of eccentric load in the car, by the action of the buffers, by those which may be applied by the anti-rebound device, by loading and unloading the car, etc..

5.3.1 Strength of the walls

5.3.1.1 For the safe operation of the lift the walls shall have a mechanical strength such that when a force of 300 N, being evenly distributed over an area of 5 cm² in round or square section, is applied at right angles to the wall at any point on either face they shall :

- a) resist without permanent deformation ;
- b) resist without elastic deformation greater than 15 mm.

See also **5.4.**(corrigendum)

5.3.1.2 Glass panels, plane or formed, placed at points normally accessible to persons shall be made of laminated glass up to a height as required in **5.2.1.2**.

5.3.2 Strength of the pit floor

5.3.2.1 The floor of the pit shall be able to support beneath each guide rail except hanging guide rails :

force in newtons, due to the mass in kilogrammes of the guide rails plus the reaction in newtons at the moment of operation of the safety gear (see **G.2.3** and **G.2.4**).

5.3.2.2 The floor of the pit shall be able to support beneath the car buffer supports 4 times the static load being imposed by the mass of the fully loaded car :

$$4 \cdot g_n \cdot (P + Q)$$

where :

P = masses of the empty car and components supported by the car, i.e. part of the travelling cable, compensating ropes/chains (if any), etc. in kilogrammes ;

Q = rated load (mass) in kilogrammes ;

g_n = standard acceleration of free fall, [9,81 (m/s²)] ;

5.3.2.3 The floor of the pit shall be able to support beneath the counterweight buffer supports, or the balancing weight travelling area, 4 times the static load being imposed by the mass of the counterweight or the balancing weight :

$$4 \cdot g_n \cdot (P + q \cdot Q) \quad \text{for counterweight}$$

$$4 \cdot g_n \cdot q \cdot P \quad \text{for balancing weight}$$

where :

P = masses of the empty car and components supported by the car, i.e. part of the travelling cable, compensating ropes/chains (if any), etc. in kilogrammes ;

Q = rated load (mass) in kilogrammes ;

g_n = standard acceleration of free fall, [9,81 (m/s²)] ;

q = balance factor (see **G.2.4**).

5.3.3 Strength of the ceiling

Notwithstanding the requirements of **6.3.1** and/or **6.4.1**, in the case of hanging guide rails the suspension points shall be able to take at least the loads and forces according to **G.5.1**.

5.4 Construction of the walls of lift wells and landing doors facing a car entrance

5.4.1 The following requirements relating to landing doors and walls, or parts of walls, facing a car entrance shall apply over the full height of the well.

For clearances between car and wall of the lift well facing the car entrance, see **11**.

5.4.2 The assembly comprising the landing doors and any wall or part of a wall facing the car entrance shall form an imperforate surface over the full entrance width of the car, excluding the operational clearances of doors.

5.4.3 Below each landing door sill the wall of the lift well shall comply with the following requirements :

a) it shall form a vertical surface which is directly connected to the landing door sill, whose height is at least half the unlocking zone plus 50 mm and whose width is at least the clear opening of the car access plus 25 mm on both sides ;

b) this surface shall be continuous and be composed of smooth and hard elements, such as metal sheets, and shall be capable of withstanding a force of 300 N applied at a right angle to the wall at any point, being evenly distributed over an area of 5 cm² in round or square section, it shall resist :

1) without permanent deformation ;

2) without elastic deformation greater than 10 mm ;

c) any projections shall not exceed 5 mm. Projections exceeding 2 mm shall be chamfered at least 75° to the horizontal ;

d) furthermore, it shall be either :

1) connected to the lintel of the next door, or

2) extended downwards using a hard smooth chamfer whose angle to the horizontal plane shall be at least 60°. The projection to this chamfer on the horizontal plane shall not be less than 20 mm.

5.5 Protection of any spaces located below the car, the counterweight or the balancing weight

If accessible spaces do exist below the car, the counterweight or the balancing weight, the base of the pit shall be designed for an imposed load of at least 5 000 N/m², and :

- a) either there shall be installed below the counterweight buffer or under the travelling area of the balancing weight, a solid pier extending down to solid ground, or
- b) the counterweight or the balancing weight shall be equipped with safety gear.

NOTE : Lift wells should preferably not be situated above a space accessible to persons.

5.6 Protection in the well

5.6.1 The travelling area of the counterweight or the balancing weight shall be guarded by means of a rigid screen extending from a position of not more than 0,30 m above the lift pit floor to a position at least 2,50 m.

The width shall be at least equal to that of the counterweight *or balancing weight (corrigendum)* plus 0,10 m on each side.

If this partition is perforate, EN 294, subclause 4.5.1 has to be respected.

5.6.2 Where the well contains several lifts there shall be a partition between the moving parts of different lifts.

If this partition is perforate, EN 294, subclause 4.5.1 has to be respected.

5.6.2.1 This partition shall extend at least from the lowest point of travel of the car, the counterweight or the balancing weight to a height of 2,50 m above the floor of the lowest landing.

The width shall be as to prevent access from one pit to another, except where the conditions of **5.2.2.2.2** are met.

5.6.2.2 The partition shall extend through the full height of the well if the horizontal distance between the edge of the car roof and a moving part (car, counterweight or balancing weight) of an adjacent lift is less than 0,50 m.

The width of the partition shall be at least equal to that of the moving part, or part of this, which is to be guarded, plus 0,10 m on each side.

5.7 Headroom and pit

5.7.1 Top clearances for traction drive lifts

The top clearances for traction drive lifts, as required in the following, are illustrated in **annex K**.

5.7.1.1 When the counterweight rests on its fully compressed buffer(s), the following four conditions shall be satisfied at the same time :

- a) the car guide rail lengths shall be such as would accommodate a further guided travel, expressed in metres, of at least $0,1 + 0,035 v^2$ ⁴⁾ ;
- b) the free vertical distance between the level of the highest area on the car roof whose dimensions comply with **8.13.2** (areas on parts according to **5.7.1.1 c)** excluded) and the level of the lowest part of the ceiling of the well (including beams and components located under the ceiling) situated in the projection of the car, expressed in metres, shall be at least $1,0 + 0,035 v^2$;
- c) the free vertical distance, expressed in metres, between the lowest parts of the ceiling of the well and :
- 1) the highest pieces of equipment fixed on the roof of the car enclosure, except for those covered in 2) below, shall be at least $0,3 + 0,035 v^2$;
 - 2) the highest part of the guide shoes or rollers, of the rope attachments and of the header or parts of vertically sliding doors, if any, shall be at least $0,1 + 0,035 v^2$;
- d) there shall be above the car sufficient space to accommodate a rectangular block not less than 0,50 m x 0,60 m x 0,80 m resting on one of its faces. For lifts with direct roping, the suspension ropes and their attachments may be included in this space, provided that no rope centre-line shall be at a distance exceeding 0,15 m from at least one vertical surface of the block.

5.7.1.2 When the car rests on its fully compressed buffers, the counterweight guide rail lengths shall be such as would accommodate a further guided travel expressed in metres, of at least $0,1 + 0,035 v^2$.

5.7.1.3 When the slowdown of the machine is monitored, in accordance with **12.8**, the value of $0,035 v^2$ in **5.7.1.1** and **5.7.1.2** for calculation of clearances may be reduced :

- a) to one half for lifts whose rated speed does not exceed 4 m/s ; however, this value shall not be less than 0,25 m ;
- b) to one third for lifts whose rated speed exceeds 4 m/s ; however, this value shall not be less than 0,28 m.

5.7.1.4 For lifts which are fitted with compensating ropes having a tensioning pulley equipped with an anti-rebound device (braking or lock-down device), the value of $0,035 v^2$ may be replaced in the calculation of the clearances by a figure related to the possible travel of that pulley (depending on the roping used) plus 1/500 of the travel of the car, with a minimum of 0,20 m to take account of the elasticity of the ropes.

⁴⁾ $0,035 v^2$ represents half the gravity stopping distance corresponding to 115 % of the rated speed :

$$1/2 \cdot \frac{(1,15 v)^2}{2 \cdot g_n} \quad 0,0337 v^2 \text{ rounded to } 0,035 v^2.$$

5.7.2 Top clearances for positive drive lifts

5.7.2.1 The guided travel of the car upwards from the top floor until it strikes the upper buffers shall be at least 0,50 m. The car shall be guided to the limit of its buffer stroke.

5.7.2.2 When the upper buffers are fully compressed by the car, the following three conditions shall be satisfied at the same time :

a) the free vertical distance between the level of the highest area on the car roof whose dimensions comply with **8.13.2** (areas on parts according to **5.7.2.2 b)** excluded) and the level of the lowest part of the ceiling of the well (including beams and components located under the ceiling) situated in the projection of the car, shall be at least 1 m ;

b) the free vertical distance between the lowest part of the ceiling of the well and :

1) the highest pieces of equipment fixed on the car roof, except for those covered by 2) below, shall be at least 0,30 m ;

2) the highest part of the guide shoes or rollers, of the rope attachments, or of the header, or the parts of vertically sliding doors, if any, shall be at least 0,10 m ;

c) there shall be above the car sufficient space to accommodate a rectangular block not less than 0,50 m x 0,60 m x 0,80 m resting on one of its faces. For lifts with direct roping, the suspension ropes or chains and their attachments may be included in this space, provided that no rope, or chain, centre-line shall be at a distance exceeding 0,15 m from at least one vertical surface of the block.

5.7.2.3 When the car rests on its fully compressed buffers, the guide rail lengths of the balancing weight, if there is one, shall be such as would accommodate a further guided travel of at least 0,30 m.

5.7.3 Pit

5.7.3.1 The lower part of the well shall consist of a pit, the bottom of which shall be smooth and approximately level, except for any buffer and guide rail bases and water drainage devices.

After the building-in of guide rail fixings, buffers, any grids, etc., the pit shall be impervious to infiltration of water.

5.7.3.2 If there is an access door to the pit, other than the landing door, it shall comply with the requirements of **5.2.2**.

Such a door shall be provided if the pit depth exceeds 2,50 m and if the layout of the building so permits.

If there is no other access a permanent means shall be provided inside the well, easily accessible from the landing door, to permit competent persons to descend safely to the floor of the pit. This shall not project into the clear running space of the lift equipment.

5.7.3.3 When the car rests on its fully compressed buffers, the following three conditions shall be satisfied at the same time :

- a) there shall be in the pit sufficient space to accommodate a rectangular block not less than 0,50 m x 0,60 m x 1,0 m resting on one of its faces ;
- b) the free vertical distance between the bottom of the pit and the lowest parts of the car, shall be at least 0,50 m. This distance may be reduced to a minimum of 0,10 m within a horizontal distance of 0,15 m between :
 - 1) apron or parts of the vertically sliding car door(s) and the adjacent wall(s) ;
 - 2) the lowest parts of the car and the guide rails ;
- c) the free vertical distance between the highest parts fixed in the pit, for instance a tensioning device for compensation ropes being in its highest position and the lowest parts of the car, except for items detailed in b) 1) and b) 2) above, shall be at least 0,30 m.

5.7.3.4 There shall be in the pit :

- a) stopping device(s) accessible on opening the door(s) to the pit, and from the pit floor, in conformity with the requirements of **14.2.2** and **15.7** ;
- b) a socket outlet (**13.6.2**) ;
- c) means to switch the lift well lighting (**5.9**), accessible on opening the door(s) to the pit.

5.8 Exclusive use of the lift well

The well shall be exclusively used for the lift. It shall not contain cables or devices, etc., other than for the lift. The well may, however, contain heating equipment for the lift well excluding steam heating and high pressure water heating. However, any control and adjustment devices of the heating apparatus shall be located outside the well.

In the case of lifts according to **5.2.1.2**, it is regarded as "well" in the case where enclosures :

- a) are present : the area inside the enclosure ;
- b) are missing : the area being inside a horizontal distance of 1,50 m from movable components of the lift (see **5.2.1.2**).

5.9 Lighting of the well

The well shall be provided with permanently installed electric lighting, giving an intensity of illumination of at least 50 lux, 1 m above the car roof and the pit floor, even when all doors are closed.

This lighting shall comprise one lamp at most 0,50 m from the highest and lowest points in the well with intermediate lamp(s) (*corrigendum*).

If use is made of the exception provided for in **5.2.1.2**, this lighting may not be necessary if the electric lighting existing in the neighbourhood of the well is sufficient.

5.10 Emergency release

If there is a risk for persons working in the well being trapped and no means are provided to escape, either through the car, or through the well, alarm devices shall be installed at places where this risk exists.

The alarm devices shall fulfil the requirements of **14.2.3.2** and **14.2.3.3**.

6 Machine and pulley rooms

6.1 General provisions

6.1.1 Lift machines, their associated equipment and pulleys, shall be in a special room, comprising solid walls, ceiling, floor and door and/or trap, and shall be accessible only to authorized persons (maintenance, inspection and rescue).

Machine or pulley rooms shall not be used for purposes other than lifts. They shall not contain ducts, cables or devices other than for the lift.

These rooms may, however, contain :

- a) machines for service lifts or escalators ;
- b) equipment for air-conditioning or heating of these rooms, excluding steam heating and high pressure water heating ;
- c) fire detectors or extinguishers, with a high operating temperature, appropriate for the electrical equipment, stable over a period of time, and suitably protected against accidental impact.

6.1.2 Diverter pulleys may be installed in the headroom of the well provided that they are located outside the projection of the car roof and that examinations and tests and maintenance operations can be carried out in complete safety from the car roof or from outside the well.

However, a diverter pulley, with single or double wrap, may be installed above the car roof for diverting towards the counterweight or the balancing weight, provided that its shaft can be reached in complete safety from the car roof.

6.1.3 The traction sheave may be installed in the well, provided that :

- a) the examinations and tests and the maintenance operations may be carried out from the machine room ;
- b) the openings between the machine room and the well are as small as possible.

6.2 Access

6.2.1 Access to the interior of the machine and pulley rooms shall :

- a) be capable of being properly lit by a permanent electric light fixture(s) ;
- b) be easy to use in complete safety in all circumstances without necessitating entry into private premises.

6.2.2 A safe access for persons to machine and pulley rooms shall be provided. For preference this should be effected entirely by way of stairs. If it is not possible to install stairs, ladders satisfying the following requirements shall be used :

- a) the access to the machine and pulley room shall not be situated more than 4 m above the level accessible by stairs ;
- b) ladders shall be fastened to the access in such a way that they cannot be removed ;
- c) ladders exceeding 1,50 m in height shall, when in position for access, form an angle between 65° and 75° to the horizontal and shall not be liable to slip or turn over ;
- d) the clear width of the ladder shall be at least 0,35 m, the depth of the steps shall not be less than 25 mm and in the case of vertical ladders the distance between the steps and the wall behind the ladder shall not be less than 0,15 m ; the steps shall be designed for a load of 1500 N ;
- e) adjacent to the top end of the ladder there shall be at least one hand hold within easy reach ;
- f) around a ladder, within a horizontal distance of 1,50 m, the risk of falling by more than the height of the ladder shall be prevented.

6.3 Construction and equipment of machine rooms

6.3.1 Mechanical strength, floor surface

6.3.1.1 Machine rooms shall be so constructed to withstand the loads and forces to which they are intended to be subjected.

They shall be in durable material not favouring the creation of dust.

6.3.1.2 Room floors shall be of non-slip material, e.g. troweled concrete, corrugated iron.

6.3.2 Dimensions

6.3.2.1 The dimensions of machine rooms shall be sufficient to permit easy and safe working on equipments (*corrigendum*), especially the electrical equipment.

In particular there shall be provided at least a clear height of 2 m at working areas, and :

- a) a clear horizontal area in front of the control panels and the cabinets. This area is defined as follows :

- 1) depth, measured from the external surface of the enclosures, at least 0,70 m ;
- 2) width, the greater of the following values : 0,50 m or the full width of the cabinet or panel ;
- b) a clear horizontal area of at least 0,50 m x 0,60 m for maintenance and inspection of moving parts at points where this is necessary and, if need be, manual emergency operation (**12.5.1**).

6.3.2.2 The clear height for movement shall not be less than 1,80 m.

The access ways to the clear spaces mentioned in **6.3.2.1** shall have a width of at least 0,50 m. This value may be reduced to 0,40 m where there are no moving parts.

This full height for movement is taken to the underside of the structural roof beams and measured from both :

- a) the floor of the access area ;
- b) the floor of the working area.

6.3.2.3 There shall be a clear vertical distance of at least 0,30 m above the rotating parts of the machine.

6.3.2.4 When the machine room floor comprises a number of levels differing by more than 0,50 m, stairways or steps and guard rails shall be provided.

6.3.2.5 When the floor of the machine rooms has any recesses greater than 0,50 m deep and less than 0,50 m wide, or any ducts, they shall be covered.

6.3.3 Doors and trap doors

6.3.3.1 Access doors shall have a minimum width of 0,60 m and a minimum height of 1,80 m. They shall not open towards the inside of the room.

6.3.3.2 Access trap doors for persons shall give a clear passage of at least 0,80 m x 0,80 m, and shall be counterbalanced.

All trap doors, when they are closed, shall be able to support two persons, each counting for 1000 N on an area of 0,20 m x 0,20 m at any position, without permanent deformation.

Trap doors shall not open downwards, unless they are linked to retractable ladders. Hinges, if any, shall be of a type which cannot be unhooked.

When a trap door is in the open position, precautions shall be taken to prevent the fall of persons (e.g. a guard rail).

6.3.3.3 The doors or trap doors shall be fitted with locks having keys, which can be opened without a key from inside the room.

Trap doors used only for access of material may be locked from the inside only.

6.3.4 Other openings

The dimension of holes in the slab and room floor shall be reduced to a minimum for their purpose.

With the aim of removing the danger of objects falling through openings situated above the well, including those for electric cables, ferrules shall be used, which project at least 50 mm above the slab or finished floor.

6.3.5 Ventilation

The machine rooms shall be suitably ventilated. Should the well be ventilated through the machine room, this has to be taken into account. Stale air from other parts of the building shall not be extracted directly into the machine room. It shall be such that the motors, and equipment, as well as electric cables, etc., are protected as far as it is reasonably practicable from dust, harmful fumes and humidity.

6.3.6 Lighting and socket outlets

The machine room shall be provided with permanently installed electric lighting on the basis of at least 200 lux at floor level. The supply for this lighting shall be in conformity with **13.6.1**.

A switch placed inside close to the access point(s), at an appropriate height, shall control lighting of the room.

At least one socket outlet (**13.6.2**) shall be provided.

6.3.7 Handling of equipment

One or more metal supports or hooks with the indication of the safe working load (**15.4.5**), as appropriate, are provided in the machine room ceiling or on the beams, conveniently positioned to permit the hoisting of heavy equipment (see **0.2.5** and **0.3.14**).

6.4 Construction and equipment of pulley rooms

6.4.1 Mechanical strength, floor surface

6.4.1.1 The pulley rooms shall be so constructed to withstand the loads and forces to which they will normally be subjected.

They shall be in durable material, not favouring the creation of dust.

6.4.1.2 The floors of the pulleys rooms shall be of non-slip material, e. g. troweled concrete, corrugated iron.

6.4.2 Dimensions

6.4.2.1 Pulley room dimensions shall be sufficient to provide easy and safe access for maintenance personnel to all the equipment.

The requirements of **6.3.2.1 b)** and **6.3.2.2, sentence two and three**, are applicable.

6.4.2.2 The height under the ceiling shall be at least 1,50 m.

6.4.2.2.1 There shall be a clear space of at least 0,30 m high above the pulleys.

6.4.2.2.2 If there are control panels and cabinets in the pulley room the provisions of **6.3.2.1** and **6.3.2.2** apply to this room.

6.4.3 Doors and trap doors

6.4.3.1 Access doors shall have a minimum width of 0,60 m and minimum height of 1,40 m. They shall not open towards the inside of the room.

6.4.3.2 Access trap doors for persons shall give a clear passage of at least 0,80 m x 0,80 m and shall be counterbalanced.

All trap doors, when they are closed, shall be able to support two persons, each counting for 1000 N on an area of 0,20 m x 0,20 m at any position, without permanent deformation.

Trap doors shall not open downwards, unless they are linked to retractable ladders. Hinges, if any, shall be of a type which cannot be unhooked.

When a trap door is in the open position, precautions shall be taken to prevent the fall of persons (e.g. a guard rail).

6.4.3.3 Doors or trap doors shall be fitted with locks having a key, which can be opened without a key from inside the room.

6.4.4 Other openings

The dimensions of holes in the slab and pulley room floor shall be reduced to a minimum for their purpose.

With the aim of removing the danger of objects falling through openings situated over the well, including those for electric cables, ferrules shall be used which project at least 50 mm above the slab or finished floor.

6.4.5 Stopping device

A stopping device, in conformity with **14.2.2** and **15.4.4**, shall be installed in the pulley room, close to the point(s) of access.

6.4.6 Temperature

If there is a risk of frost or condensation in the pulley rooms, precautions shall be taken to protect the equipment.

If the pulley rooms also contain electrical equipment, the ambient temperature shall be similar to that of the machine room.

6.4.7 Lighting and socket outlets

The pulley room shall be provided with permanently installed electric lighting, giving an intensity of an illumination of at least 100 lux at the pulley(s). The supply for this lighting shall be in conformity with **13.6.1**.

A switch, placed inside, close to the access point, at an appropriate height, shall control the lighting of the room.

At least one socket outlet in conformity with **13.6.2** shall be provided. See also **6.4.2.2.2**.

If there are control panels and cabinets in the pulley room, the provisions of **6.3.6** apply.

7 Landing doors

7.1 General provisions

The openings in the well giving access to the lift car shall be provided with imperforate landing doors.

When closed, the clearance between panels, or between panels and uprights, lintels or sills, shall be as small as possible.

This condition is considered to be fulfilled when the operational clearances do not exceed 6 mm. This value, due to wear, may reach 10 mm. These clearances are measured at the back of recesses, if present.

7.2 Strength of doors and their frames

7.2.1 Doors and their frames shall be constructed in such a way that they will not become deformed in the course of time. To this effect, it is recommended that they are made of metal.

7.2.2 Behaviour under fire conditions

Landing doors shall comply with the regulations relevant to the fire protection for the building concerned. PrEN 81-8 describes a method of the fire test.

7.2.3 Mechanical strength.

7.2.3.1 Doors, with their locks, shall have a mechanical strength such that in the locked position and when a force of 300 N, being evenly distributed over an area of 5 cm² in round or square section, is applied at right angles to the panel at any point on either face they shall :

- a) resist without permanent deformation ;
- b) resist without elastic deformation greater than 15 mm ;
- c) during and after such a test the safety function of the door shall not be affected.

7.2.3.2 Under the application of a manual force (without a tool) of 150 N in the direction of the opening of the leading door panel(s) of horizontally sliding doors and folding doors, at the most unfavourable point, the clearances defined in **7.1** may exceed 6 mm, but they shall not exceed :

- a) 30 mm for side opening doors ;
- b) 45 mm in total for centre opening doors.

7.2.3.3 Door panels made of glass shall be fixed in such a way that forces demanded by this standard which may be applied are transferred without damaging the fixing of the glass.

Doors, with glass of dimensions greater than stated in **7.6.2**, shall use laminated glass and, additionally withstand the pendulum shock tests, described in **annex J**.

After the tests the safety function of the door shall not be affected.

7.2.3.4 The fixing of the glass in doors shall ensure that the glass cannot slip out of the fixings, even when sinking.

7.2.3.5 The glass panels shall have markings giving the following information :

- a) name of the supplier and trade mark ;
- b) type of glass ;
- c) thickness (e.g. 8/8/0,76 mm).

7.2.3.6 To avoid dragging of children hands, automatic power operated horizontally sliding doors made of glass of dimensions greater than stated in **7.6.2** shall be provided with means to minimise the risk, such as :

- a) reducing the coefficient of friction between hands and glass ;
- b) making the glass opaque up to a height of 1,10 m ;
- c) sensing the presence of fingers, or
- d) other equivalent methods.

7.3 Height and width of entrances

7.3.1 Height

Landing doors shall be such that a minimum clear height of the entrance is 2 m.

7.3.2 Width

The clear entrance of the landing doors shall not extend more than 50 mm in width beyond the clear car entrance on both sides.

7.4 Sills, guides, door suspension

7.4.1 Sills

Every landing entrance shall incorporate a sill of sufficient strength to withstand the passage of loads being introduced into the car.

NOTE : It is recommended that a slight counter slope be provided in front of each landing sill to avoid water from washing, sprinkling, etc., draining into the well.

7.4.2 Guides

7.4.2.1 Landing doors shall be designed to prevent, during normal operation, derailment, mechanical jamming, or displacement at the extremities of their travel.

Where the guides may become ineffective due to wear, corrosion or fire, emergency guidance shall be provided to maintain the landing doors in their position.

7.4.2.2 Horizontally sliding landing doors shall be guided top and bottom.

7.4.2.3 Vertically sliding landing doors shall be guided at both sides.

7.4.3 Suspension of vertically sliding doors

7.4.3.1 Panels of vertically sliding landing doors shall be fixed to two independent suspension elements.

7.4.3.2 Suspension ropes, chains, belts shall be designed with a safety factor of at least 8.

7.4.3.3 The pitch diameter of suspension rope pulleys shall be at least 25 times the rope diameter.

7.4.3.4 Suspension ropes and chains shall be guarded against leaving the pulley grooves or sprockets.

7.5 Protection in relation to door operation

7.5.1 General

The doors and their surrounds shall be designed in such a way as to minimize risk of damage or injury due to jamming of a part of the person, clothing or other object.

To avoid the risk of shearing during operation, the exterior face of automatic power operated sliding doors shall not have recesses or projections exceeding 3 mm. Edges of these shall be chamfered in the opening direction of movement.

Exception to these requirements is made for the access to the unlocking triangle defined in **annex B**.

7.5.2 Power operated doors

Power operated doors shall be designed to reduce to a minimum the harmful consequences of a person being struck by a door panel.

To this effect, the following requirements shall be met :

7.5.2.1 Horizontally sliding doors

7.5.2.1.1 Automatic power operated doors

7.5.2.1.1.1 The effort needed to prevent the door closing shall not exceed 150 N. This measurement shall not be made in the first third of the travel of the door.

7.5.2.1.1.2 The kinetic energy of the landing door and the mechanical elements which are rigidly connected to it, calculated or measured ⁵⁾ at the average closing speed shall not exceed 10 J.

The average closing speed of a sliding door is calculated over its whole travel, less :

- a) 25 mm at each end of the travel in the case of centrally closing doors ;
- b) 50 mm at each end of the travel in the case of side closing doors.

7.5.2.1.1.3 A protective device shall automatically initiate re-opening of the door in the event of a person being struck, or about to be struck, by the door in crossing the entrance during the closing movement.

This protective device may be that for the car door (see **8.7.2.1.1.3**).

The effect of the device may be neutralized during the last 50 mm of travel of each leading door panel.

In the case of a system, which makes the protective device inoperative after a predetermined time, to counteract persistent obstructions when closing the door, the kinetic energy defined in **7.5.2.1.1.2** shall not exceed 4 J during movement of the door with the protective device inoperative.

7.5.2.1.1.4 In the case of coupled car and landing doors operated simultaneously, the requirements of **7.5.2.1.1.1** and **7.5.2.1.1.2** are valid for the joined door mechanism.

7.5.2.1.1.5 The effort needed to prevent a folding door from opening shall not exceed 150 N. This measurement shall be made with the door collapsed such that the adjacent outer edges of the folded panels or equivalent, e.g. door frame, are at a distance of 100 mm.

7.5.2.1.2 Non-automatic power operated doors

When the closing of the door is carried out under the continuous control and supervision of the user, by continuous pressure on a button or similar (hold-to-run control), the average closing speed of the fastest panel shall be limited to 0,3 m/s, when the kinetic energy, calculated or measured as stated in **7.5.2.1.1.2**, exceeds 10 J.

7.5.2.2 Vertically sliding doors

This type of sliding door shall only be used for goods passenger lifts.

⁵⁾ Measured using, for example, a device consisting of a graduated piston acting on a spring with a spring constant of 25 N/mm, and fitted with an easy sliding ring allowing the extreme point of movement at the moment of impact to be measured. An easy calculation allows the graduation corresponding to the limits fixed to be determined.

Power closing shall only be used if the following four conditions are fulfilled at the same time :

- a) the closing is carried out under the continuous control and supervision of the users ;
- b) the average closing speed of the panels is limited to 0,3 m/s ;
- c) the car door is of construction as provided for in **8.6.1** ;
- d) the car door is at least two-thirds closed before the landing door begins to close.

7.5.2.3 Other types of doors

When using other types of doors, e.g. swing doors, with power operation, where there is a risk when opening or closing, of striking persons, precautions similar to those laid down for power operated sliding doors shall be taken.

7.6 Local lighting and “car here” signal lights

7.6.1 Local lighting

The natural or artificial lighting of the landings in the vicinity of landing doors shall be at least 50 lux at floor level, such that a user can see ahead when he is opening the landing door to enter the lift, even if the car light has failed (see **0.2.5**).

7.6.2 “Car here” indication

In the case of landing doors with manual opening, the user needs to know, before opening the door, whether the car is there or not.

To this effect, there shall be installed, either :

- a) one or more transparent vision panels conforming to the following four conditions at the same time :
 - 1) mechanical strength as specified in **7.2.3.1**, with the exception of the pendulum shock tests ;
 - 2) minimum thickness of 6 mm ;
 - 3) minimum glazed area per landing door of 0,015 m² with a minimum of 0,01 m² per vision panel ;
 - 4) width of at least 60 mm, and at most 150 mm. The lower edge of vision panels which are wider than 80 mm shall be at least 1 m above floor level, or
- b) an illuminated “car here” signal which can only light up when the car is about to stop or has stopped at the particular landing. The signal shall remain illuminated whilst the car remains there.

7.7 Locking and closed landing door check

7.7.1 Protection against the risk of falling

It shall not be possible in normal operation to open a landing door (or any of the panels in the case of a multi-panel door) unless the car has stopped, or is on the point of stopping, in the unlocking zone of that door.

The unlocking zone shall not extend more than 0,20 m above and below the landing level.

In the case, however, of mechanically operated car and landing doors operating simultaneously, the unlocking zone may extend to a maximum of 0,35 m above and below the landing level.

7.7.2 Protection against shearing

7.7.2.1 With the exception of **7.7.2.2**, it shall not be possible in normal operation to start the lift nor keep it in motion if a landing door, or any of the panels in the case of a multi-panel door is open. However, preliminary operations for the movement of the car may take place.

7.7.2.2 Operation with doors open is permitted in the following zones :

a) in the unlocking zone to permit levelling or relevelling at the corresponding floor level, provided the requirements of **14.2.1.2** are met ;

b) in a zone extending to a maximum height of 1,65 m above the landing level to permit the loading or unloading of the car, provided the requirements of **8.4.3**, **8.14** and **14.2.1.5** are met, and :

1) the clear height between the landing door header and the floor of the car, in any position, shall not be less than 2 m, and

2) whatever the position of the car inside this zone, it must be possible, without special operation, to effect the complete closure of the landing door.

7.7.3 Locking and emergency unlocking

Each landing door shall be provided with a locking device satisfying the conditions of **7.7.1**. This device shall be protected against deliberate misuse.

7.7.3.1 Locking

The effective locking of the landing door in the closed position shall precede the movement of the car. However, preliminary operations for the movement of the car may take place. The locking must be proved by an electric safety device in conformity with **14.1.2**.

7.7.3.1.1 The car shall not be able to start until the locking elements are engaged by at least 7 mm ; see **figure 3**.

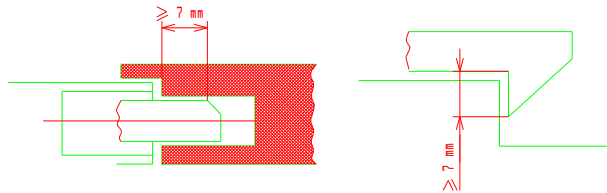


Figure 3 : Examples of locking elements

7.7.3.1.2 The element of the electric safety device proving the locked condition of the door panel(s) shall be positively operated without any intermediate mechanism by the locking element. It shall be foolproof but adjustable if necessary.

Specific case : In the case of locking devices used in installations requiring special protection against risks of humidity or explosion the connection may be only positive, provided the link between the mechanical lock and the element of the electric safety device proving the locked condition, can only be interrupted by destroying deliberately the locking device.

7.7.3.1.3 For hinged doors, locking shall be effected as near as possible to the vertical closing edge(s) of the doors, and maintained even in the case of panels sagging.

7.7.3.1.4 The locking elements and their fixings shall be resistant to shock, and be made or reinforced with metal.

7.7.3.1.5 The engagement of the locking elements shall be achieved in such a way that a force of 300 N in the opening direction of the door does not diminish the effectiveness of locking.

7.7.3.1.6 The lock shall resist, without permanent deformation during the test laid down in **F.1**, a minimum force at the level of the lock and in the direction of opening of the door of :

- a) 1000 N in the case of sliding doors ;
- b) 3000 N on the locking pin, in the case of hinged doors.

7.7.3.1.7 The locking action shall be effected and maintained by the action of gravity, permanent magnets, or springs. The springs shall act by compression, be guided and of such dimensions that, at the moment of unlocking, the coils are not compressed solid.

In the event of the permanent magnet (or spring) no longer fulfilling its function, gravity shall not cause unlocking.

If the locking element is maintained in position by the action of a permanent magnet, it shall not be possible to neutralize its effect by simple means (e.g. heat or shock).

7.7.3.1.8 The locking device shall be protected against the risk of an accumulation of dust, which could hinder its proper functioning.

7.7.3.1.9 Inspection of the working parts shall be easy, as, for example, by use of a vision panel.

7.7.3.1.10 In the case where the lock contacts are in a box, the fixing screws for the cover shall be of the captive type, so that they remain in the holes in the cover or box when opening the cover.

7.7.3.2 Emergency unlocking

Each of the landing doors shall be capable of being unlocked from the outside with the aid of a key, which will fit the unlocking triangle as defined in **annex B**.

Keys of this type shall be given only to a responsible person. They shall be accompanied by a written instruction detailing the essential precautions to be taken in order to avoid accidents which could result from an unlocking which was not followed by effective relocking.

After an emergency unlocking, the locking device shall not be able to remain in the unlocked position with the landing door closed.

In the case of landing doors driven by the car door, a device (either weight or springs) shall ensure the automatic closing of the landing door if this door becomes open, for whatever reason, when the car is outside the unlocking zone.

7.7.3.3 The locking device is regarded as a safety component and shall be verified according to the requirements in **F.1**.

7.7.4 Electrical device for proving the landing door closed

7.7.4.1 Each landing door shall be provided with an electric safety device in conformity with **14.1.2** for proving the closed position, so that the conditions imposed by **7.7.2** are satisfied.

7.7.4.2 In the case of horizontally sliding landing doors, coupled with car doors, this device may be in common with the device for proving the locked condition, provided that it is dependent upon the effective closing of the landing door.

7.7.4.3 In the case of hinged landing doors, this device shall be placed adjacent to the closing edge of the door or on the mechanical device proving the closed condition of the door.

7.7.5 Requirements common to devices for proving the locked condition and the closed condition of the door

7.7.5.1 It shall not be possible, from positions normally accessible to persons, to operate the lift with a landing door open or unlocked, after one single action not forming part of the normal operating sequence.

7.7.5.2 The means used to prove the position of a locking element shall have positive operation.

7.7.6 Sliding doors with multiple, mechanically linked panels

7.7.6.1 If a sliding door comprises several directly mechanically linked panels, it is permitted :

- a) to place the device required in **7.7.4.1** or **7.7.4.2**, on a single panel, and
- b) to lock only one panel, provided that this single locking prevents the opening of the other panel(s) by hooking the panels in the closed position in case of telescopic doors.

7.7.6.2 If a sliding door comprises several indirectly, mechanically linked panels (e.g. by rope, belt or chain), it is permitted to lock only one panel provided that this single locking will prevent the opening of other panels, and that these are not fitted with a handle.

The closed position of the other panel(s), not locked by the locking device, shall be proved by an electric safety device in conformity with **14.1.2**.

7.8 Closing of automatically operated doors

In normal operation, automatically operated landing doors shall be closed after the necessary period of time, which may be defined according to the traffic using the lift, in the absence of a command for the movement of the car.

8 Car, counterweight and balancing weight

8.1 Height of car

8.1.1 The interior clear height of the car shall be at least 2 m.

8.1.2 The clear height of the car entrance(s) for the normal access of users shall be at least 2 m.

8.2 Available car area, rated load, number of passengers

8.2.1 General case

To prevent an overloading of the car by persons, the available area of the car shall be limited. To this effect the relationship between rated load and maximum available area is given in **table 1.1**.

Recesses and extensions, even of height less than 1 m, whether protected or not by separating doors, are only permitted if their area is taken into account in the calculation of maximum available car area.

Any available area in the entrance, when the doors are closed, shall also be taken into account.

Furthermore, overloading of the car shall be monitored by means of a device according to **14.2.5**.

Table 1.1

Rated load, mass	Maximum available car area	Rated load, mass	Maximum available car area
kg	m²	kg	m²
100 ¹⁾	0,37	900	2,20
180 ²⁾	0,58	975	2,35
225	0,70	1000	2,40
300	0,90	1050	2,50
375	1,10	1125	2,65
400	1,17	1200	2,80
450	1,30	1250	2,90
525	1,45	1275	2,95
600	1,60	1350	3,10
630	1,66	1425	3,25
675	1,75	1500	3,40
750	1,90	1600	3,56
800	2,00	2000	4,20
825	2,05	2500 ³⁾	5,00

1) Minimum for 1 person lift.

2) Minimum for 2 persons lift.

3) Beyond 2500 kg add 0,16 m² for each extra 100 kg.

For intermediate loads the area is determined by linear interpolation.

8.2.2 Goods passenger lifts

The requirements of **8.2.1** shall be applied and, in addition, design calculations shall take into account not only the rated load but also the weight of handling devices, which may enter the car.

8.2.3 Number of passengers

The number of passengers shall be obtained from :

- a) either, the formula, $\frac{\text{rated load}}{75}$, and the result rounded down to the nearest whole number, or
- b) **table 1.2** which gives the smaller value.

Table 1.2

Number of passengers	Minimum available car area m ²	Number of passengers	Minimum available car area m ²
1	0,28	11	1,87
2	0,49	12	2,01
3	0,60	13	2,15
4	0,79	14	2,29
5	0,98	15	2,43
6	1,17	16	2,57
7	1,31	17	2,71
8	1,45	18	2,85
9	1,59	19	2,99
10	1,73	20	3,13

Beyond 20 passengers add 0,115 m² for each extra passenger.

8.3 Walls, floor and roof of the car

8.3.1 The car shall be completely enclosed by walls, floor and roof, the only permissible openings being as follows :

- a) entrances for the normal access of users ;
- b) emergency trap doors and doors ;
- c) ventilation apertures.

8.3.2 The walls, floor and roof shall have sufficient mechanical strength. The assembly comprising the sling, guide shoes, walls, floor and roof of the car shall have sufficient mechanical strength to resist the forces which will be applied in normal lift operation, in safety gear operation or impact of the car on its buffers.

8.3.2.1 Each wall of the car shall have a mechanical strength such that when a force of 300 N, being evenly distributed over an area of 5 cm² in round or square section, is applied at right angles to the wall at any point from the inside of the car towards the outside, it shall :

- a) resist without any permanent deformation ;
- b) resist without elastic deformation greater than 15 mm.

8.3.2.2 Walls with glass shall use laminated glass and, additionally withstand the pendulum shock tests, described in **annex J**.

After the tests the safety function of the wall shall not be affected.

Car walls with glass placed lower than 1,10 m from the floor shall have a handrail at a height between 0,90 m and 1,10 m. This handrail shall be fastened independently from the glass.

8.3.2.3 The fixing of the glass in the wall shall ensure that the glass cannot slip out of the fixings, even when sinking.

8.3.2.4 The glass panels shall have markings giving the following information :

- a) name of the supplier and trademark ;
- b) type of glass ;
- c) thickness (e.g. 8/8/0,76 mm).

8.3.2.5 The car roof shall satisfy the requirements of **8.13**.

8.3.3 The walls, floor and roof shall not be made of materials likely to become dangerous through too great a flammability or through the nature and quantity of gas and fumes they may generate.

8.4 Apron

8.4.1 Each car sill shall be fitted with an apron, which extends to the full width of the clear landing entrance, which it faces. This vertical section shall be extended downwards by a chamfer whose angle with the horizontal plane shall be greater than 60°. The projection of this chamfer of the horizontal plane shall be not less than 20 mm.

8.4.2 The height of the vertical portion shall be at least 0,75 m.

8.4.3 In the case of a lift with a docking operation (**14.2.1.5**), the height of the vertical portion shall be such that, with the car in the highest loading or unloading position, it extends at least 0,10 m below the landing sill.

8.5 Car entrance

Car entrances shall be provided with doors.

8.6 Car doors

8.6.1 The car doors shall be imperforate, except for goods passenger lifts, which may use vertically sliding car doors, opening upwards, and these may be in mesh or perforated panel form. The dimensions of the mesh or perforations shall not exceed 10 mm horizontally and 60 mm vertically.

8.6.2 The car doors when closed shall, apart from the necessary clearances, completely close the car entrances.

8.6.3 When closed, the clearance between panels, or between panels and uprights, lintels or sills, shall be as small as possible.

This condition is considered to be fulfilled when the operational clearances do not exceed 6 mm. This value, due to wear, may reach 10 mm. These clearances are measured at the back of recesses, if present. Exception is made for vertically sliding doors, according to **8.6.1**.

8.6.4 In the case of hinged doors, they shall strike stops to prevent them swinging outside the car.

8.6.5 The car door shall be fitted with a vision panel(s) if the landing door has a vision panel(s) (**7.6.2 a**) unless the car door is automatic and remains in the open position when the car is stationary at the level of a landing.

When a vision panel(s) is fitted it shall satisfy the requirements of **7.6.2 a**) and be positioned in the car door such that it is in visual alignment with the landing door vision panel(s) when the car is at the level of the landing.

8.6.6 Sills, guides, door suspension

The provisions of **7.4** relevant to car doors shall be observed.

8.6.7 Mechanical strength

8.6.7.1 Car doors in the closed position shall have a mechanical strength such that when a force of 300 N, being evenly distributed over an area of 5 cm² in round or square section, is applied at right angles to the door, at any point, from the inside of the car towards the outside, they shall :

- a) resist without permanent deformation ;
- b) resist without elastic deformation greater than 15 mm ;
- c) during and after such a test the safety function of the door shall not be affected.

8.6.7.2 Door panels made of glass shall be fixed in such a way that forces demanded by this standard which may be applied are transferred without damaging the fixing of the glass.

Doors, with glass of dimensions greater than stated in **7.6.2**, shall use laminated glass and, additionally withstand the pendulum shock tests, described in **annex J**.

After the tests the safety function of the door shall not be affected.

8.6.7.3 The fixing of the glass in doors shall ensure that the glass cannot slip out of the fixings, even when sinking.

8.6.7.4 The glass panels shall have markings giving the following information :

- a) name of the supplier and trademark ;
- b) type of glass ;
- c) thickness (e.g. 8/8/0,76 mm).

8.6.7.5 To avoid dragging of children hands, automatic power operated horizontally sliding doors made of glass of dimensions greater than stated in **7.6.2** shall be provided with means to minimise the risk, such as :

- a) reducing the coefficient of friction between hands and glass ;
- b) making the glass opaque up to a height of 1,10 m ;
- c) sensing the presence of fingers, or
- d) other equivalent methods.

8.7 Protection during operation of doors

8.7.1 General

The doors and their surrounds shall be designed in such a way as to minimize risk of damage or injury due to jamming of a part of the person, clothing or other object.

To avoid the risk of shearing during operation, the face on the car side of automatic power operated sliding doors shall not have recesses or projections exceeding 3 mm. Edges of these shall be chamfered in the opening direction of movement. Both is not required for perforated doors in accordance with **8.6.1**.

8.7.2 Power operated doors

Power operated doors shall be designed to reduce to a minimum the harmful consequences of a person being struck by a door panel.

To this effect the following requirements shall be met.

In the case of coupled car and landing doors, operated simultaneously the following requirements are valid for the joint door mechanism.

8.7.2.1 Horizontally sliding doors

8.7.2.1.1 Automatic power operated doors

8.7.2.1.1.1 The effort needed to prevent the door closing shall not exceed 150 N. This measurement shall not be made in the first third of the travel of the door.

8.7.2.1.1.2 The kinetic energy of the car door and the mechanical elements, which are rigidly connected to it, calculated or measured ⁶⁾ at the average closing speed shall not exceed 10 J.

The average closing speed of a sliding door is calculated over its whole travel, less :

- a) 25 mm at each end of the travel in the case of centrally closing doors ;
- b) 50 mm at each end of the travel in the case of side closing doors.

8.7.2.1.1.3 A protective device shall automatically initiate re-opening of the door in the event of a person being struck, or about to be struck, by the door in crossing the entrance during the closing movement.

The effect of the device may be neutralized during the last 50 mm of travel of each leading door panel.

In the case of a system which makes the protection device inoperative after a predetermined period of time, to counteract persistent obstructions when closing the door, the kinetic energy defined in **8.7.2.1.1.2** shall not exceed 4 J during movement of the door with the protective device inoperative.

8.7.2.1.1.4 The effort needed to prevent a folding door from opening shall not exceed 150 N. This measurement shall be made with the door collapsed such that the adjacent outer edges of the folded panels or equivalent, e.g. doorframe, are at a distance of 100 mm.

8.7.2.1.1.5 If a folding door is going into a recess the distance between any outer edge of the doorfold and the recess shall be at least 15 mm .

⁶⁾ Measured using, for example, a device consisting of a graduated piston acting on a spring with a spring constant of 25 N/mm, and fitted with an easy sliding ring allowing the extreme point of movement at the moment of impact to be measured. An easy calculation allows the graduation corresponding to the limits fixed to be determined.

8.7.2.1.2 Non-automatic power operated doors

When the closing of the door is carried out under the continuous control and supervision of the user, by continuous pressure on a button or similar (hold-to-run control), the average closing speed of the fastest panel shall be limited to 0,3 m/s, when the kinetic energy, calculated or measured as stated in 7.5.2.1.1.2, exceeds 10 J.

8.7.2.2 Vertically sliding doors

This type of sliding door shall only be used for goods passenger lifts.

Power closing shall only be used if the following four conditions are fulfilled at the same time :

- a) the closing is carried out under the continuous control and supervision of the users ;
- b) the average closing speed of the panels is limited to 0,3 m/s ;
- c) the car door is of construction as provided for in 8.6.1 ;
- d) the car door is at least two-thirds closed before the landing door begins to close.

8.8 Reversal of closing movement

If doors are automatic power operated a device permitting the closing movement to be reversed shall be located with the other car controls.

8.9 Electrical device for proving the car doors closed

8.9.1 With the exception of 7.7.2.2, it shall not be possible in normal operation to start the lift nor keep it in motion if a car door (or any of the panels in the case of a multi-panel door) is open. However, preliminary operations for the movement of the car may take place.

8.9.2 Each car door shall be provided with an electric safety device for proving the closed position in conformity with 14.1.2 so that the conditions imposed by 8.9.1 are satisfied.

8.9.3 If the car door needs to be locked (see 11.2.1 c)), the locking device shall be designed and operated in analogy to the landing door locking device (see 7.7.3.1 and 7.7.3.3).

8.10 Sliding doors with multiple, mechanically linked panels

8.10.1 If a sliding door comprises several directly mechanically linked panels, it is permitted :

- a) to place the device (8.9.2) either :
 - 1) on a single panel (the rapid panel in the case of telescopic doors), or
 - 2) on the door driving element if the mechanical connection between this element and the panels is direct, and

b) in the case and conditions laid down in **11.2.1 c)**, to lock only one panel, provided that this single locking prevents the opening of the other panels by hooking the panels in the closed position in the case of telescopic doors.

8.10.2 If a sliding door comprises several indirectly mechanically linked panels (e.g. by rope, belt or chain), it is permitted to place the device (**8.9.2**) on a single panel, provided that :

- a) this is not the driven panel, and
- b) the driven panel is directly mechanically linked to the door driving element.

8.11 Opening the car door

8.11.1 In order to permit passengers to leave the lift car, if the lift stops for any reason close to a landing, it shall be possible with the car stopped and the supply to the door operator (if any) disconnected :

- a) to open or partly open the car door by hand from the landing ;
- b) to open or partly open the car door together with the landing door linked to it if they are coupled, by hand from within the car.

8.11.2 The opening of the car door provided for in **8.11.1** shall be able to be carried out at least in the unlocking zone.

The force necessary to open it shall not exceed 300 N.

In the case of lifts covered by **11.2.1 c)**, the opening of the car door from inside the car shall be possible only when the car is in the unlocking zone.

8.11.3 The opening of the car door with the lift in motion, the rated speed of which exceeds 1 m/s, shall require a force greater than 50 N.

This requirement is not obligatory in the unlocking zone.

8.12 Emergency trap doors and emergency doors

8.12.1 Assistance to passengers in the car shall always come from outside, being provided in particular by the emergency operation mentioned in **12.5**.

8.12.2 If there is an emergency trap door in the car roof to permit the rescue and evacuation of passengers, it shall measure at least 0,35 m x 0,50 m.

8.12.3 Emergency doors may be used in the case of adjacent cars, provided, however, that the horizontal distance between cars does not exceed 0,75 m (see **5.2.2.1.2**).

If emergency doors exist, they shall measure at least 1,80 m high and 0,35 m wide.

8.12.4 If emergency trap doors or doors are installed, they shall conform to **8.3.2** and **8.3.3**, also to the following :

8.12.4.1 Emergency trap doors and doors shall be provided with a means for manual locking.

8.12.4.1.1 Emergency trap doors shall be opened from outside the car without a key and from inside the car with a key suited to the triangle defined in **annex B**.

Emergency trap doors shall not open towards the inside of the car.

Emergency trap doors in the open position shall not project beyond the edge of the lift car.

8.12.4.1.2 Emergency doors shall be opened from outside the car without a key and from inside the car using a key suited to the triangle defined in **annex B**.

Emergency doors shall not open towards the outside of the car.

Emergency doors shall not be located in the path of a counterweight or a balancing weight or in front of a fixed obstacle (except for beams separating the cars) preventing passage from one car to another.

8.12.4.2 The locking called for in **8.12.4.1** shall be proved by means of an electric safety device in conformity with **14.1.2**.

This device shall cause the lift to stop if the locking ceases to be effective.

Restoring the lift to service shall only be possible after deliberate relocking.

8.13 Car roof

In addition to **8.3**, the car roof shall fulfil the following requirements :

8.13.1 The car roof shall be able to support at any position the mass of two persons, each counting for 1000 N on an area of 0,20 m x 0,20 m, without permanent deformation.

8.13.2 The car roof shall have at one point a clear area for standing of at least 0,12 m², in which the lesser dimension is at least 0,25 m.

8.13.3 The car roof shall be provided with a balustrade where the free distance in a horizontal plane, beyond and perpendicular to its outer edge exceeds 0,30 m.

The free distances shall be measured to the wall of the well allowing a larger distance in recesses, the width or height of which is less than 0,30 m.

The balustrade shall fulfil the following requirements :

8.13.3.1 It shall consist of a handrail, a toe guard of 0,10 m height and an intermediate bar at half the height of the balustrade.

8.13.3.2 Considering the free distance in a horizontal plane beyond the outer edge of the handrail of the balustrade, its height shall be at least :

- a) 0,70 m where the free distance is up to 0,85 m ;
- b) 1,10 m where the free distance exceeds 0,85 m.

8.13.3.3 The horizontal distance between the outer edge of the handrail and any part in the well (counterweight or balancing weight, switches, rails, brackets, etc.) shall be at least 0,10 m.

8.13.3.4 The balustrade at the access side(s) shall provide safe and easy access to the car roof.

8.13.3.5 The balustrade shall be located within 0,15 m maximum of the edges of the car roof.

8.13.4 In case of a balustrade, a warning sign or a notice about the danger of leaning over the balustrade shall be fixed to it, where appropriate.

8.13.5 Glass used for the car roof shall be laminated.

8.13.6 Pulleys and/or sprockets fixed to the car shall have protection according to **9.7**.

8.14 Car header

If a gap can exist between the car roof and the header of a landing door when this door is opened, the upper part of the car entrance shall be extended upwards, over the whole width of the landing door, by a rigid vertical panel to fill the gap considered. This possibility is to be envisaged in particular in the case of a lift with a docking operation (**14.2.1.5**).

8.15 Equipment on top of the car

The following shall be installed on top of the car :

- a) control device in conformity with **14.2.1.3** (inspection operation) ;
- b) stopping device in conformity with **14.2.2** and **15.3** ;
- c) socket outlet in conformity with **13.6.2**.

8.16 Ventilation

8.16.1 Cars with imperforate doors shall be provided with ventilation apertures in the upper and lower parts of the car.

8.16.2 The effective area of ventilation apertures situated in the upper part of the car shall be at least 1 % of the available car area, and the same also applies for the apertures in the lower part of the car.

The gaps round the car doors may be taken into account in the calculation of the area of ventilation holes, up to 50 % of the required effective area.

8.16.3 Ventilation apertures shall be built or arranged in such a way that it is not possible to pass a straight rigid rod 10 mm in diameter through the car walls from the inside.

8.17 Lighting

8.17.1 The car shall be provided with electrical lighting that is permanently installed ensuring a light intensity of at least 50 lux at floor level and on the control devices.

8.17.2 If lighting is of the incandescent type, there shall be at least two lamps connected in parallel.

8.17.3 The car shall be continuously illuminated when the lift is in use.

In the case of automatically power operated doors the light may be switched off when the car is parked at a landing with the doors closed in accordance with **7.8**.

8.17.4 There shall be an automatically rechargeable emergency supply, which is capable of feeding at least a 1 W lamp for 1 h in case of an interruption of the normal lighting supply. This lighting shall come on automatically upon failure of the normal lighting supply.

8.17.5 If the supply referred to **8.17.4** is also used to feed the emergency alarm signal called for in **14.2.3**, its capacity shall be rated accordingly.

8.18 Counterweight and balancing weight

The use of a balancing weight is defined in **12.2.1**.

8.18.1 If the counterweight or the balancing weight incorporates filler weights, necessary measures shall be taken to prevent their displacement. To this effect the following shall be used :

- a) either a frame in which the fillers are secured, or
- b) if the fillers are made of metal, and if the rated speed of the lifts does not exceed 1 m/s, a minimum of two tie-rods on which the fillers are secured.

8.18.2 Pulleys and/or sprockets fixed to the counterweight or to the balancing weight shall have protection according to **9.7**.

9 Suspension, compensation and overspeed protection

9.1 Suspension

9.1.1 Cars, counterweights or balancing weights shall be suspended from steel wire ropes, or steel chains with parallel links (Galle type) or roller chains.

9.1.2 The ropes shall correspond to the following requirements :

- a) the nominal diameter of the ropes shall be at least 8 mm ;
- b) the tensile strength of the wires shall be :
 - 1) 1570 N/mm² or 1770 N/mm² for ropes of single tensile, or
 - 2) 1370 N/mm² for the outer wires and 1770 N/mm² for the inner wires of ropes of dual tensile.
- c) the other characteristics (construction, extension, ovality, flexibility, tests....) shall at least correspond to those specified in the relevant European standards.

9.1.3 The minimum number of ropes or chains shall be two.

Ropes or chains shall be independent.

9.1.4 Where reeving is used the number to take into account is that of the ropes or chains and not the falls.

9.2 Sheave, pulley, drum and rope diameter ratios, rope/chain terminations

9.2.1 The ratio between the pitch diameter of sheaves, pulleys or drums and the nominal diameter of the suspension ropes shall be at least 40, regardless of the number of strands.

9.2.2 The safety factor of the suspension ropes shall be calculated according to **annex N**. In no case it shall be less than :

- a) 12 in the case of traction drive with three ropes or more ;
- b) 16 in the case of traction drive with two ropes ;
- c) 12 in the case of drum drive.

The safety factor is the ratio between the minimum breaking load, in newtons, of one rope and the maximum force, in newtons, in this rope, when the car is stationary at the lowest landing, with its rated load.

9.2.3 The junction between the rope and the rope termination, according to **9.2.3.1**, shall be able to resist at least 80 % of the minimum breaking load of the rope.

9.2.3.1 The ends of the ropes shall be fixed to the car, counterweight or balancing weight, or suspension points of the dead parts of reeved ropes by means of metal or resin filled sockets, self tightening wedge type sockets, heart shaped thimbles with at least three suitable rope grips, hand spliced eyes, ferrule secured eyes, or any other system with equivalent safety.

9.2.3.2 The fixing of the ropes on the drums shall be carried out using a system of blocking with wedges, or using at least two clamps or any other system with equivalent safety.

9.2.4 The safety factor of the suspension chains shall be at least 10.

The safety factor is defined in a manner analogous to that indicated in **9.2.2** for ropes.

9.2.5 The ends of each chain shall be fixed to the car, counterweight or balancing weight, or suspension points of the dead parts of reeved chains by suitable terminations. The junction between the chain and the chain termination shall be able to resist at least 80 % of the minimum breaking load of the chain.

9.3 Rope traction

Rope traction shall be such that the following three conditions are fulfilled :

- a) the car shall be maintained at floor level without slip when loaded to 125 % as per **8.2.1** or **8.2.2** ;
- b) it shall be ensured that any emergency braking causes the car, whether empty or with rated load, to decelerate with a value not exceeding the setting of the buffer, including reduced stroke buffer ;
- c) it shall not be possible to raise the empty car when the counterweight is resting on the buffers, and the lift machine is rotated in the “up” direction.

Design considerations are given in **annex M**.

9.4 Winding up of ropes for positive drive lifts

9.4.1 The drum, which can be used in the conditions laid down in **12.2.1 b)** shall be helically grooved and the grooves shall be suited to the ropes used.

9.4.2 When the car rests on its fully compressed buffers, one and a half turns of rope shall remain in the grooves of the drum.

9.4.3 There shall only be one layer of rope wound on the drum.

9.4.4 The angle of deflection (fleet angle) of the ropes in relation to the grooves shall not exceed 4°.

9.5 Distribution of load between the ropes or the chains

9.5.1 An automatic device shall be provided for equalizing the tension of suspension ropes or chains, at least at one of their ends.

9.5.1.1 For chains engaging with sprockets, the ends fixed to the car as well as the ends fixed to the balancing weight shall be provided with such equalization devices.

9.5.1.2 For chains in the case of multiple return sprockets on the same shaft, these sprockets shall be able to rotate independently.

9.5.2 If springs are used to equalize the tension they shall work in compression.

9.5.3 In the case of two rope or two chain suspension of the car an electric safety device in conformity with **14.1.2** shall cause the lift to stop in case of abnormal relative extension of one rope or chain.

9.5.4 The devices for adjusting the length of ropes or chains shall be made in such a way that these devices cannot work themselves loose after adjustment.

9.6 Compensation with ropes

9.6.1 Whenever compensating ropes are used the following shall apply :

- a) tensioning pulleys shall be used ;
- b) the ratio between the pitch diameter of the tensioning pulleys and the nominal diameter of the compensating ropes shall be at least 30 ;
- c) tensioning pulleys shall have protection according to **9.7** ;
- d) the tension shall be provided by gravity ;
- e) the minimum tension shall be checked by an electric safety device in conformity with **14.1.2**.

9.6.2 For lifts whose rated speed exceeds 3,5 m/s there shall be, in addition to **9.6.1**, an anti-rebound device.

The operation of the anti-rebound device shall initiate the stopping of the lift machine by means of an electric safety device in conformity with **14.1.2**.

9.7 Protection for traction sheaves, pulleys and sprockets

9.7.1 For traction sheaves, pulleys and sprockets, provisions shall be made according to **table 2** to avoid :

- a) bodily injury ;
- b) the ropes/chains leaving the pulleys/sprockets, if slack ;
- c) the introduction of objects between ropes/chains and pulleys/sprockets.

Table 2

Location of traction sheaves, pulleys and sprockets			Risk according to 9.7.1		
			a	b	c
At the car	on the roof		x	x	x
	under the floor			x	x
On the counterweight / balancing weight				x	x
In the machine room			x ²⁾	x	x ¹⁾
In the pulley room				x	
In the well	Headroom	above car	x	x	
		beside car		x	
	between pit and headroom			x	x ¹⁾
	pit		x	x	x
At the overspeed governor and its tensioning pulley				x	x ¹⁾
x risk must be taken into account.					
1) required only if the ropes/chains are entering the traction sheave or the pulley/sprocket horizontally or at any angle above the horizontal up to a maximum of 90°.					
2) protection shall be nip guards as a minimum.					

9.7.2 The devices used shall be constructed so that the rotating parts are visible, and do not hinder examination and maintenance operation. If they are perforated the gaps shall comply with EN 294, table 4.

The dismantling shall be necessary only in the following cases :

- a) replacement of a rope/chain ;
- b) replacement of a pulley/sprocket ;
- c) re-cutting of the grooves.

9.8 Safety gear

9.8.1 General provisions

9.8.1.1 The car shall be provided with a safety gear capable of operating in the downward direction and capable of stopping a car carrying the rated load, at the tripping speed of the overspeed governor, even if the suspension devices break, by gripping the guide rails, and of holding the car there.

A safety gear operating in upward direction may be used in accordance with **9.10**.

NOTE : The safety gear operating devices shall preferably be located at the lower part of the car.

9.8.1.2 In the case envisaged in **5.5 b)**, the counterweight or the balancing weight shall also be equipped with safety gear, operating only on a downward moving counterweight or balancing weight, capable of stopping it, at the tripping speed of the overspeed governor (or if the suspension devices break in the specific case of **9.8.3.1**), by gripping the guide rails, and of holding the counterweight or the balancing weight there.

9.8.1.3 The safety gear is regarded as a safety component and shall be verified according to the requirements in **F.3**.

9.8.2 Conditions of use for different types of safety gear

9.8.2.1 Car safety gear shall be of the progressive type if the rated speed of the lift exceeds 1 m/s. It can be :

- a) of the instantaneous type with buffered effect if the rated speed does not exceed 1 m/s ;
- b) of the instantaneous type if the rated speed does not exceed 0,63 m/s.

9.8.2.2 If the car carries several safety gears they shall all be of the progressive type.

9.8.2.3 The safety gear of the counterweight or balancing weight shall be of the progressive type if the rated speed exceeds 1 m/s, otherwise the safety gear may be of the instantaneous type.

9.8.3 Methods of tripping

9.8.3.1 The safety gear of the car, counterweight or balancing weight shall each be tripped by its own overspeed governor.

When the rated speed does not exceed 1 m/s, the safety gear of a counterweight or balancing weight may be tripped by the failure of the suspension gear or by a safety rope.

9.8.3.2 Safety gears shall not be tripped by devices, which operate electrically, hydraulically or pneumatically.

9.8.4 Retardation

For progressive safety gear the average retardation in the case of free fall with rated load in the car shall lie between $0,2 g_n$ and $1 g_n$.

9.8.5 Release

9.8.5.1 When a safety gear has tripped its release shall require the intervention of a competent person.

9.8.5.2 The release and automatic reset of a safety gear on the car, counterweight or balancing weight shall only be possible by raising the car, counterweight or balancing weight.

9.8.6 Constructional conditions

9.8.6.1 Jaws or blocks of safety gears shall not be used as guide shoes.

9.8.6.2 For safety gear of the instantaneous type with buffered effect, the design of the buffering systems shall be of the energy accumulation type with buffered return movement or the energy dissipation type, satisfying the requirements of **10.4.2** or **10.4.3**.

9.8.6.3 If the safety gear is adjustable, the final setting shall be sealed.

9.8.7 Inclination of the car floor

When the car safety gear operates, the floor of the car without or with the load uniformly distributed shall not incline more than 5 % from its normal position.

9.8.8 Electrical checking

When the car safety gear is engaged, an electric safety device in conformity with **14.1.2**, mounted on the car shall initiate the stopping of the machine before or at the moment of safety gear operation.

9.9 Overspeed governor

9.9.1 Tripping of the overspeed governor for the car safety gear shall occur at a speed at least equal to 115 % of the rated speed and less than :

- a) 0,8 m/s for instantaneous safety gears except for the captive roller type, or
- b) 1 m/s for safety gears of the captive roller type, or
- c) 1,5 m/s for instantaneous safety gears with buffered effect and for progressive safety gear used for rated speeds not exceeding 1,0 m/s, or
- d) $1,25 \cdot v + \frac{0,25}{v}$ in metres per second for progressive safety gear for rated speeds exceeding 1,0 m/s.

NOTE : For lifts where the rated speed exceeds 1 m/s, it is recommended to choose a tripping speed as close as possible to the value required in d).

9.9.2 For lifts with very heavy rated loads and low rated speeds, the overspeed governor shall be specially designed for this purpose.

NOTE : It is recommended to choose a tripping speed as close as possible to the lower limit indicated in **9.9.1**.

9.9.3 The tripping speed of an overspeed governor for a counterweight or balancing weight safety gear shall be higher than that for the car safety gear according to **9.9.1**, not, however exceeding it by more than 10 %.

9.9.4 The tensile force in the overspeed governor rope produced by the governor, when tripped, shall be at least the greater of the following two values :

- a) twice that necessary to engage the safety gear, or
- b) 300 N.

Overspeed governors using only traction to produce the force shall have grooves which :

- a) have been submitted to an additional hardening process, or
- b) have an undercut in accordance with **M.2.2.1**.

9.9.5 The direction of rotation, corresponding to the operation of the safety gear, shall be marked on the overspeed governor.

9.9.6 Overspeed governor ropes

9.9.6.1 The overspeed governor shall be driven by a wire rope designed for that purpose.

9.9.6.2 The minimum breaking load of the rope shall be related by a safety factor of at least 8 to the tensile force produced in the rope of the overspeed governor when tripped taking into account a friction factor μ_{\max} equal to 0,2 for traction type overspeed governor.

9.9.6.3 The nominal rope diameter shall be at least 6 mm.

9.9.6.4 The ratio between the pitch diameter of the pulleys for the overspeed governor rope and the nominal rope diameter shall be at least 30.

9.9.6.5 The overspeed governor rope shall be tensioned by a tensioning pulley. This pulley (or its tensioning weight) shall be guided.

9.9.6.6 During the engagement of the safety gear, the overspeed governor rope and its attachments shall remain intact, even in the case of a braking distance greater than normal.

9.9.6.7 The overspeed governor rope shall be easily detachable from the safety gear.

9.9.7 Response time

The response time of the overspeed governor before tripping shall be sufficiently short not to permit a dangerous speed to be reached before the moment of safety gear operation (see **F.3.2.4.1**).

9.9.8 Accessibility

9.9.8.1 The overspeed governor shall be accessible and reachable for inspection and maintenance.

9.9.8.2 If located in the well the overspeed governor shall be accessible and reachable from outside the well.

9.9.8.3 The requirement of **9.9.8.2** does not apply if the following three conditions are fulfilled :

- a) the tripping of the overspeed governor according to **9.9.9** is effected by means of a remote control, except cableless, from outside the well whereby an involuntary tripping is not effected and the actuation device is not accessible to unauthorised persons, and
- b) the overspeed governor is accessible for inspection and maintenance from the roof of the car or from the pit, and

c) the overspeed governor returns after tripping automatically into the normal position, as the car, counterweight or balancing weight is moved in the upward direction.

However the electrical parts may return into the normal position by remote control from the outside of the well which shall not influence the normal function of the overspeed governor.

9.9.9 Possibility of tripping the overspeed governor

During checks or tests it shall be possible to operate the safety gear at a lower speed than that indicated in **9.9.1** by tripping the overspeed governor in a safe way.

9.9.10 If the overspeed governor is adjustable, the final setting shall be sealed.

9.9.11 Electrical checking

9.9.11.1 The overspeed governor or another device shall, by means of an electric safety device in conformity with **14.1.2**, initiate the stopping of the lift machine before the car speed, either up or down, reaches the tripping speed of the governor.

However, for rated speeds not exceeding 1 m/s, this device may operate at latest at the moment when the tripping speed of the governor is reached.

9.9.11.2 If after release of the safety gear (**9.8.5.2**) the overspeed governor does not automatically reset itself, an electric safety device in conformity with **14.1.2** shall prevent the starting of the lift while the overspeed governor is not in the reset position. This device shall, however, be made inoperative in the case provided for in **14.2.1.4 c) 5) 2) (corrigendum)**.

9.9.11.3 The breakage or excessive rope stretch of the governor rope shall cause the motor to stop by means of an electric safety device in conformity with **14.1.2**.

9.9.12 The overspeed governor is regarded as a safety component and shall be verified according to the requirements in **F.4**.

9.10 Ascending car overspeed protection means

A traction drive lift shall be provided with ascending car overspeed protection means conforming to the following :

9.10.1 The means, comprising speed monitoring and speed reducing elements, shall detect uncontrolled movement of the ascending car at a minimum 115 % of the rated speed, and maximum as defined in **9.9.3**, and shall cause the car to stop, or at least reduce its speed to that for which the counterweight buffer is designed.

9.10.2 The means shall be capable of performing as required in **9.10.1** without assistance from any lift component that, during normal operation, controls the speed or retardation, or stops the car, unless there is built-in redundancy.

A mechanical linkage to the car, whether or not such linkage is used for any other purpose, may be used to assist in this performance.

9.10.3 The means shall not allow a retardation of the empty car in excess of $1\ g_n$ during the stopping phase.

9.10.4 The means shall act :

- a) to the car, or
- b) to the counterweight, or
- c) on the rope system (suspension or compensating), or
- d) on the traction sheave (e.g. on the sheave directly or on the same shaft in the immediate vicinity of the sheave).

9.10.5 The means shall operate an electric safety device in conformity with **14.1.2** if it is engaged.

9.10.6 When the means has been activated its release shall require the intervention of a competent person.

9.10.7 The release of the means shall not require the access to the car or the counterweight.

9.10.8 After its release, the means shall be in a condition to operate.

9.10.9 If the means requires external energy to operate, the absence of energy shall cause the lift to stop and keep it stopped. This does not apply for guided compressed springs.

9.10.10 The speed monitoring element of the lift to cause the ascending car overspeed protection means to actuate shall be, either :

- a) a governor conforming to the requirements of **9.9**, or
- b) a device conforming to **9.9.1**, **9.9.2**, **9.9.3**, **9.9.7**, **9.9.8.1**, **9.9.9**, **9.9.11.2**, and where equivalence to **9.9.4**, **9.9.6.1**, **9.9.6.2**, **9.9.6.5**, **9.9.10** and **9.9.11.3** is assured.

9.10.11 The ascending car overspeed protection means is regarded as a safety component and shall be verified according to the requirements in **F.7**.

10 Guide rails, buffers and final limit switches

10.1 General provisions concerning guide rails

10.1.1 The guide rails, their joints and attachments shall be sufficient to withstand the loads and forces imposed on them in order to ensure a safe operation of the lift.

The aspects of safe operation of the lift concerning guide rails are :

- a) car, counterweight or balancing weight -guidance shall be assured ;
- b) deflections shall be limited to such an extent, that due to them :
 - 1) unintended unlocking of the doors shall not occur ;
 - 2) operation of the safety devices shall not be affected, and
 - 3) collision of moving parts with other parts shall not be possible.

Stresses shall be limited taking into account the distribution of the rated load in the car as given in **G.2**, **G.3** and **G.4** or according to the intended use as negotiated (**0.2.5**).

NOTE : **Annex G** describes a method of selecting guide rails.

10.1.2 Permissible stresses and deflections

10.1.2.1 The permissible stresses shall be determined by :

$$\sigma_{perm} = \frac{R_m}{S_t}$$

where :

σ_{perm} = permissible stress in newtons per square millimetre ;

R_m = tensile strength in newtons per square millimetre ;

S_t = safety factor.

The safety factor has to be taken from **table 3**.

Table 3 : Safety factors for guide rails

Load cases	Elongation (A_5)	Safety factor
Normal use loading	$A_5 \geq 12 \%$	2,25
	$8 \% \leq A_5 \leq 12 \%$	3,75
Safety gear operation	$A_5 \geq 12 \%$	1,8
	$8 \% \leq A_5 \leq 12 \%$	3,0

Materials with elongations less than 8 % are regarded as too brittle and shall not be used.

For guide rails in accordance with ISO 7465, the values of σ_{perm} given in **table 4** can be used.

Table 4 : Permissible stresses σ_{perm}

Values in newtons per square millimetre

Load cases	R_m		
	370	440	520
Normal use loading	165	195	230
Safety gear operation	205	244	290

10.1.2.2 For T-profile guide rails the maximum calculated permissible deflections are :

- a) 5 mm in both directions for car, counterweight or balancing weight guide rails on which safety gears are operating ;
- b) 10 mm in both directions for guide rails of counterweight or balancing weight without safety gears.

10.1.3 The fixing of the guide rails to their brackets and to the building shall permit compensation, either automatically or by simple adjustment, of effects due to normal settling of the building or shrinkage of concrete.

A rotation of the attachments by which the guide rails could be released shall be prevented.

10.2 Guiding of the car, counterweight or balancing weight

10.2.1 The car, counterweight or balancing weight shall each be guided by at least two rigid steel guide rails.

10.2.2 The guide rails shall be made from drawn steel, or the rubbing surfaces shall be machined, if :

- a) the rated speed exceeds 0,4 m/s ;
- b) progressive safety gears are used regardless of the speed.

10.2.3 Guide rails for counterweights or balancing weights without safety gear may be made of formed metal sheet. They shall be protected against corrosion.

10.3 Car and counterweight buffers

10.3.1 Lifts shall be provided with buffers at the bottom limit of travel of the car and counterweight.

The acting point(s) of the buffer(s) below the projection of the car shall be made obvious by an obstacle (pedestal) of a height so that **5.7.3.3** is fulfilled. For buffers with the centre of the acting area within 0,15 m from the guide rails and similar fixed devices, excluding walls, these devices are regarded as obstacles.

10.3.2 In addition to the requirements of **10.3.1** positive drive lifts shall be provided with buffers on the car top to function at the upper limit of travel.

10.3.3 Energy accumulation type buffers, with linear and non linear characteristics, shall only be used if the rated speed of the lift does not exceed 1 m/s.

10.3.4 Energy accumulation type buffers with buffered return movement shall only be used if the rated speed of the lift does not exceed 1,6 m/s.

10.3.5 Energy dissipation type buffers can be used whatever the rated speed of the lift.

10.3.6 The energy accumulation type buffers with non-linear characteristics and/or with buffered return movement and energy dissipation type buffers are regarded as safety components and shall be verified according to the requirements in **F.5**.

10.4 Stroke of car and counterweight buffers

The buffer strokes required in the following are illustrated in **annex L**.

10.4.1 Energy accumulation type buffers

10.4.1.1 Buffers with linear characteristics

10.4.1.1.1 The total possible stroke of the buffers shall be at least equal to twice the gravity stopping distance corresponding to 115 % of the rated speed ($0,135 v^2$)⁷⁾, the stroke being expressed in metres.

However, the stroke shall not be less than 65 mm.

10.4.1.1.2 Buffers shall be designed to cover the stroke defined in **10.4.1.1.1** under a static load of between 2,5 times and 4 times the sum of the mass of the car and its rated load (or the mass of the counterweight).

10.4.1.2 Buffers with non-linear characteristics

10.4.1.2.1 Energy accumulation type buffers with non linear characteristics shall fulfil the following requirements :

- a) hitting the car buffer with rated load in the car, in case of free fall with a speed of 115 % of the rated speed, the average retardation shall not be more than $1 g_n$;
- b) retardation of more than $2,5 g_n$ shall not be longer than 0,04 s ;
- c) the return speed of the car shall not exceed 1 m/s ;
- d) there shall be no permanent deformation after actuation.

10.4.1.2.2 The term “fully compressed”, mentioned in **5.7.1.1**, **5.7.1.2**, **5.7.2.2**, **5.7.2.3** and **5.7.3.3** means a compression of 90 % of the installed buffer height.

10.4.2 Energy accumulation type buffers with buffered return movement

The requirements of **10.4.1** apply to this type of buffer.

10.4.3 Energy dissipation type buffers

10.4.3.1 The total possible stroke of the buffers shall be at least equal to the gravity stopping distance corresponding to 115 % of the rated speed ($0,0674 v^2$), the stroke being expressed in metres.

7) $\frac{2 \cdot (1,15 v)^2}{2 \cdot g_n} = 0,1348 v^2$ rounded to $0,135 v^2$.

10.4.3.2 When the slowdown of lift at the ends of its travel is monitored according to **12.8**, the speed at which the car (or the counterweight) comes into contact with the buffers may be used instead of the rated speed, when calculating the buffer stroke according to **10.4.3.1**. However, the stroke shall not be less than :

a) one half of the stroke calculated according to **10.4.3.1** if the rated speed does not exceed 4 m/s.

In any event, the stroke shall not be less than 0,42 m ;

b) one third of the stroke calculated according to **10.4.3.1** if the rated speed exceeds 4,0 m/s ;

In any event the stroke shall not be less than 0,54 m.

10.4.3.3 Energy dissipation type buffers shall fulfil the following requirements :

a) hitting the car buffer with a rated load in the car, in case of free fall with a speed of 115 % of the rated speed, the average retardation shall not be more than $1 g_n$;

b) retardation of more than $2,5 g_n$ shall not be longer than 0,04 s ;

c) there shall be no permanent deformation after actuation.

10.4.3.4 The normal operation of the lift shall depend on the return of the buffers to their normal extended position after operation. The device for checking this shall be an electric safety device in conformity with **14.1.2**.

10.4.3.5 Buffers, if hydraulic, shall be so constructed that the fluid level can easily be checked.

10.5 Final limit switches

10.5.1 General

Final limit switches shall be provided.

Final limit switches shall be set to function as close as possible to the terminal floors, without risk of accidental operation.

They shall operate before the car (or counterweight if there is one) comes into contact with the buffers. The action of the final limit switches shall be maintained whilst the buffers are compressed.

10.5.2 Actuation of the final limit switches

10.5.2.1 Separate actuating devices shall be used for normal terminal stopping and final limit switches.

10.5.2.2 In the case of positive drive lifts, actuation of the final limit switches shall be effected :

- a) either by a device linked to the movement of the machine, or
- b) by the car and by the balancing weight, if there is one, at the top of the well, or
- c) if there is no balancing weight, by the car at the top and the bottom of the well.

10.5.2.3 In the case of traction drive lifts, actuation of the final limit switches shall be effected :

- a) either directly by the car at the top and bottom of the well, or
- b) indirectly by a device which is linked to the car, e.g. by a rope, belt or chain.

In the case b), breakage of or slack in this linkage shall cause the machine to stop by means of an electric safety device in conformity with **14.1.2**.

10.5.3 Method of operation of final limit switches

10.5.3.1 The final limit switches shall :

- a) for positive drive lifts, open directly by positive mechanical separation of the circuits feeding the motor and brake in accordance with **12.4.2.3.2**.
- b) for traction drive lifts, single or two speed, either :
 - 1) open circuits according to a) above, or
 - 2) open by an electric safety device in conformity with **14.1.2** the circuit directly supplying the coils of the two contactors in accordance with **12.4.2.3.1**, **12.7.1** and **13.2.1.1** ;
- c) in the case of variable voltage or continuously variable speed lifts, cause the rapid stopping of the machine, i.e. in the shortest time compatible with the system.

10.5.3.2 After the operation of the final limit switches, the return to service of the lift shall not occur automatically.

11 Clearances between car and wall facing the car entrance, and between car, counterweight or balancing weight

11.1 General provision

The operational clearances specified in the standard shall be maintained not only during the examination and tests before the lift is put into service, but also throughout the life of the lift.

11.2 Clearances between car and wall facing the car entrance

The following requirements are illustrated in **figures 4 and 5**.

11.2.1 The horizontal distance between the inner surface of the lift well and the sill, door frame of the car or closing edge of car sliding doors shall not exceed 0,15 m.

The distance given above :

- a) may be extended to 0,20 m over a height not exceeding 0,50 m ;
- b) may be extended to 0,20 m throughout the travel on goods passenger lifts in which the landing doors are vertically sliding ;
- c) is not limited if the car is provided with a mechanically locked door, which can only be opened in the unlocking zone of a landing door.

The operation of the lift shall automatically depend on the locking of the corresponding car door except in the cases covered in **7.7.2.2**. This locking shall be proved by an electric safety device in conformity with **14.1.2**.

11.2.2 The horizontal distance between the sill of the car and sill of the landing doors shall not exceed 35 mm.

11.2.3 The horizontal distance between the car door and the closed landing doors or the access distance between the doors during the whole of their normal operation shall not exceed 0,12 m.

11.2.4 In the case of the combination of a hinged landing door and a folding car door it shall not be possible to place a ball with a diameter of 0,15 m in any gap between the closed doors.

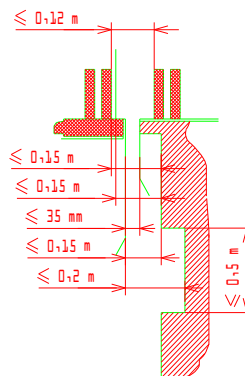


Figure 4 : Clearances between car and wall facing the car entrance

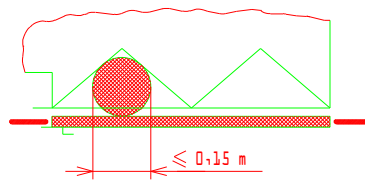


Figure 5 : Hinged landing door and folding car door - Gap

11.3 Clearances between car, counterweight or balancing weight

The car and its associated components shall be at a distance of at least 50 mm from the counterweight or balancing weight (if there is one) and its associated components.

12 Lift machine

12.1 General provision

Each lift shall have at least one machine of its own.

12.2 Drive of the car and the counterweight or balancing weight

12.2.1 The following two methods of drive are permissible :

- a) by traction (use of sheaves and ropes) ;
- b) by positive drive, i.e. :
 - 1) either use of a drum and ropes, or
 - 2) use of sprockets and chains.

The rated speed shall not exceed 0,63 m/s. Counterweights shall not be used. The use of a balancing weight is permitted.

The calculations of the driving elements shall take into account the possibility of the counterweight or the car resting on its buffers.

12.2.2 Use may be made of belts for coupling the motor or motors to the component on which the electro-mechanical brake (**12.4.1.2**) operates. In this case a minimum of two belts shall be used.

12.3 Use of overhung pulleys or sprockets

Devices according to **9.7** shall be provided.

12.4 Braking system

12.4.1 General provisions

12.4.1.1 The lift shall be provided with a braking system, which operates automatically :

- a) in the event of loss of the mains power supply ;
- b) in the event of the loss of the supply to control circuits.

12.4.1.2 The braking system shall have an electro-mechanical brake (friction type), but may, in addition, have other braking means (e.g. electric).

12.4.2 Electro-mechanical brake

12.4.2.1 This brake on its own shall be capable of stopping the machine when the car is travelling downward at rated speed and with the rated load plus 25 %. In these conditions the retardation of the car shall not exceed that resulting from operation of the safety gear or stopping on the buffer.

All the mechanical components of the brake which take part in the application of the braking action on the drum or disk shall be installed in two sets. If one of the components is not working a sufficient braking effort to slow down the car, travelling downwards at rated speed and with rated load shall continue to be exercised.

Any solenoid plunger is considered to be a mechanical part, any solenoid coil is not.

12.4.2.2 The component on which the brake operates shall be coupled to the traction sheave or drum or sprocket by direct and positive mechanical means.

12.4.2.3 To hold off the brake, in normal operation, shall require a continuous flow of current.

12.4.2.3.1 The interruption of this current shall be effected by at least two independent electrical devices, whether or not integral with those, which cause interruption of the current feeding the lift machine.

If, whilst the lift is stationary, one of the contactors has not opened the main contacts, further movement of the car shall be prevented at the latest at the next change in the direction of motion.

12.4.2.3.2 When the motor of the lift is likely to function as a generator, it shall not be possible for the electric device operating the brake to be fed by the driving motor.

12.4.2.3.3 Braking shall become effective without supplementary delay after opening of the brake release circuit.

NOTE : The use of a diode or capacitor connected directly to the terminals of the brake coil is not considered as a means of delay.

12.4.2.4 Any machine fitted with a manual emergency operating device (**12.5.1**) shall be capable of having the brake released by hand and require a constant effort to keep the brake open.

12.4.2.5 The brake shoe or pad pressure shall be exerted by guided compression springs or weights.

12.4.2.6 Band brakes shall not be used.

12.4.2.7 Brake linings shall be incombustible.

12.5 Emergency operation

12.5.1 If the manual effort required to move the car in the upward direction with its rated load does not exceed 400 N the machine shall be provided with a manual means of emergency operation allowing the car to be moved to a landing with the aid of a smooth, spokeless wheel.

12.5.1.1 If the wheel is removable, it shall be located in an easily accessible place in the machine room. It shall be suitably marked if there is any risk of confusion as to the machine for which it is intended.

An electric safety device in conformity with **14.1.2** shall be actuated when the wheel is put on the machine at the latest.

12.5.1.2 It shall be possible to check easily from the machine room whether the car is in an unlocking zone. This check may be made, for example, by means of marks on the suspension or governor ropes.

12.5.2 If the effort defined in **12.5.1** is greater than 400 N, a means of emergency electrical operation from the machine room shall be provided in accordance with **14.2.1.4**.

12.6 Speed

The speed of the lift car, half loaded, in downward motion, in mid-travel, excluding all acceleration and retardation periods, shall not exceed the rated speed by more than 5 %, when the supply is at its rated frequency, and the motor voltage is equal to the rated voltage of the equipment ⁸⁾.

⁸⁾ It is good practice that in the above conditions the speed is not lower than a value 8 % below the rated speed.

This tolerance is also applicable for the speed in the case of :

- a) levelling (**14.2.1.2 b)**) ;
- b) re-levelling (**14.2.1.2 c)**) ;
- c) inspection operation (**14.2.1.3 d)**) ;
- d) emergency electrical operation (**14.2.1.4. e)**) ;
- e) docking operation (**14.2.1.5 c)**).

12.7 Stopping the machine and checking its stopped condition

The stopping of the machine by means of an electric safety device, in conformity with **14.1.2**, shall be controlled as detailed below.

12.7.1 Motors supplied directly from A.C. or D.C. mains

The supply shall be interrupted by two independent contactors, the contacts of which shall be in series in the supply circuit. If, whilst the lift is stationary, one of the contactors has not opened the main contacts, further movement of the car shall be prevented at the latest at the next change in the direction of motion.

12.7.2 Drive using a “Ward-Leonard” system

12.7.2.1 Excitation of the generator supplied by classical elements

Two independent contactors shall interrupt, either :

- a) the motor generator loop, or
- b) the excitation of the generator, or
- c) one the loop and the other the excitation of the generator.

If, whilst the lift is stationary, one of the contactors has not opened the main contacts, further movement of the car shall be prevented, at the latest at the next change in direction of motion.

In cases b) and c) effective precautions shall be taken to prevent the rotation of the motor in the case of a residual field, if any, in the generator (e.g. suicide circuit).

12.7.2.2 Excitation of the generator supplied and controlled by static elements

One of the following methods shall be used :

- a) the same methods as specified in **12.7.2.1** ;
- b) a system consisting of :

- 1) a contactor interrupting the excitation of the generator or the motor generator loop.

The coil of the contactor shall be released at least before each change in direction of motion. If the contactor does not release, any further movement of the lift shall be prevented, and

- 2) a control device blocking the flow of energy in the static elements, and

- 3) a monitoring device to verify the blocking of the flow of energy each time the lift is stationary.

If, during a normal stopping period, the blocking by the static elements is not effective, the monitoring device shall cause the contactor to release and any further movement of the lift shall be prevented.

Effective precautions shall be taken to prevent the rotation of the motor in the case of a residual field, if any, in the generator (e.g. suicide circuit).

12.7.3 A.C. or D.C. motor supplied and controlled by static elements

One of the following methods shall be used :

- a) two independent contactors interrupting the current to the motor.

If, while the lift is stationary, one of the contactors has not opened the main contacts, any further movement shall be prevented, at the latest at the next change in direction of motion ;

- b) a system consisting of :

- 1) a contactor interrupting the current at all poles.

The coil of the contactor shall be released at least before each change in direction. If the contactor does not release, any further movement of the lift shall be prevented, and

- 2) a control device blocking the flow of energy in the static elements, and

- 3) a monitoring device to verify the blocking of the flow of energy each time the lift is stationary.

If, during a normal stopping period, the blocking of the flow of energy by the static elements is not effective, the monitoring device shall cause the contactor to release and any further movement of the lift shall be prevented.

12.7.4 Control devices according to **12.7.2.2 b) 2** or **12.7.3 b) 2)**, and monitoring devices according to **12.7.2.2 b) 3)** or **12.7.3 b) 3)** need not to be safety circuits according to **14.1.2.3**.

These devices shall only be used provided the requirements of **14.1.1** are met to achieve comparability to **12.7.3.a)**.

12.8 Monitoring the normal slowdown of the machine in case of reduced buffer stroke

12.8.1 In the case of **10.4.3.2**, devices shall check that the slowdown is effective before arrival at terminal landings.

12.8.2 If the slowdown is not effective these devices shall cause the car speed to be reduced in such a way that, if the car or the counterweight comes into contact with the buffers, the striking speed shall not exceed that for which the buffers were designed.

12.8.3 If the device checking the slowdown is not independent of the direction of travel, a device shall check that the movement of the car is in the intended direction.

12.8.4 If these devices, or some of them, are placed in the machine room :

- a) they shall be operated by a device directly coupled to the car ;
- b) the information relating to the car position shall not depend on devices driven by traction, friction, or by synchronous motors ;
- c) if a connection by tape, chain or rope is used to transmit the position of the car to the machine room, breakage of or slack in such a connecting device shall cause the machine to stop through the action of an electric safety device in conformity with **14.1.2**.

12.8.5 The control and functioning of these devices shall be so designed that together with the normal speed regulation system there results a slowdown control system complying with the requirements of **14.1.2**.

12.9 Safety devices against slack rope or slack chain

Positive drive lifts shall have a slack rope/chain device actuating an electric safety device in conformity with **14.1.2**. This device may be the same as the one required in **9.5.3**.

12.10 Motor run time limiter

12.10.1 Traction drive lifts shall have a motor run time limiter causing the de-energizing of the machine, and keep it de-energized, if :

- a) the machine does not rotate when a start is initiated ;
- b) the car/counterweight is stopped in downwards movement by an obstacle which causes the ropes to slip on the traction sheave.

12.10.2 The motor run time limiter shall function in a time which does not exceed the smaller of the following two values :

- a) 45 s ;
- b) time for travelling the full travel, plus 10 s, with a minimum of 20 s if the full travel time is less than 10 s.

12.10.3 The return to normal operation shall only be possible by manual resetting. On restoration of the power after a supply disconnection, maintaining the machine in the stopped position is not necessary.

12.10.4 The motor run time limiter shall not affect the movement of the car under either the inspection operation or the emergency electrical operation.

12.11 Protection of machinery

Effective protection shall be provided for accessible rotating parts, which may be dangerous, in particular :

- a) keys and screws in the shafts ;
- b) tapes, chains, belts ;
- c) gears, sprockets ;
- d) projecting motor shafts ;
- e) fly-ball type overspeed governors.

Exception is made for traction sheaves with protections according to **9.7**, handwinding wheels, brake drums and any similar smooth, round parts. Such parts shall be painted yellow, at least in part.

13 Electric installations and appliances

13.1 General provisions

13.1.1 Limits of application

13.1.1.1 The requirements of this standard relating to the installation and to the constituent components of the electrical equipment apply :

- a) to the main switch of the power circuit and dependent circuits ;
- b) to the switch for the car lighting circuit and dependent circuits.

The lift shall be considered as a whole, in the same way as a machine with its built in electrical equipment.

NOTE : The national requirements relating to electricity supply circuits apply as far as the input terminals of the switches. They apply to the whole lighting and socket outlet circuits of the machine room, the pulley room and the lift well and pit.

13.1.1.2 The requirements of this standard for circuits dependent on the switches referred to in **13.1.1.1** are based, as far as possible, taking into account the specific needs of lifts, on existing standards :

- a) on the international level : IEC ;
- b) on the European level : CENELEC.

Whenever one of these standards is used, its references are given, together with the limits within which it is used.

When no precise information is given, the electrical equipment used shall conform to the accepted Codes of Practice relating to safety.

13.1.1.3 The electromagnetic compatibility shall comply with the requirements of EN 12015 and EN 12016.

13.1.2 In the machine and pulley rooms protection against direct contact shall be provided by means of casings providing a degree of protection of at least IP 2X.

13.1.3 Insulation resistance of the electrical installation (CENELEC HD 384.6.61 S1)

The insulation resistance shall be measured between each live conductor and earth.

Minimum values of insulation resistance shall be taken from **table 5**.

Table 5

Nominal circuit voltage V	Test voltage (d.c.) V	Insulation resistance MΩ
SELV	250	≥ 0,25
≤ 500	500	≥ 0,5
> 500	1000	≥ 1,0

When the circuit includes electronic devices, phase and neutral conductors shall be connected together during measurement.

13.1.4 The mean value in direct current or the r.m.s. value in alternating current of the voltage between conductors or between conductors and earth, shall not exceed 250 V for control and safety circuits.

13.1.5 The neutral conductor and the protection conductor shall always be separate.

13.2 Contactors, relay-contactors, components of safety circuits

13.2.1 Contactors and relay-contactors

13.2.1.1 The main contactors, i.e. those necessary to stop the machine as per **12.7**, shall belong to the following categories as defined in EN 60947-4-1 :

- a) AC-3 for contactors for A.C. motors ;
- b) DC-3 for contactors for D.C. power.

These contactors shall, in addition allow 10 % of starting operations to be made as inching.

13.2.1.2 If, because of the power they carry, relay-contactors are used to operate the main contactors, those relay-contactors shall belong to the following categories as defined in EN 60947-5-1 :

- a) AC-15 for controlling A.C. electromagnets ;
- b) DC-13 for controlling D.C. electromagnets.

13.2.1.3 Both for the main contactors referred to in **13.2.1.1** and for the relay-contactors referred to in **13.2.1.2**, it may be assumed in the measures taken to comply with **14.1.1.1** that :

- a) if one of the break contacts (normally closed) is closed, all the make contacts are open ;
- b) if one of the make contacts (normally open) is closed, all the break contacts are open.

13.2.2 Components of safety circuits

13.2.2.1 When relay-contactors as per **13.2.1.2** are used, as relays in a safety circuit, the assumptions of **13.2.1.3** shall also apply.

13.2.2.2 If relays are used which are such that the break and make contacts are never closed simultaneously for any position of the armature, the possibility of partial attraction of the armature (**14.1.1.1 f**) can be disregarded.

13.2.2.3 Devices (if any) connected after electrical safety devices shall meet the requirements of **14.1.2.2.3** as regards the creepage distances and the air gaps (not the separation distances).

This requirement does not apply to the devices mentioned in **13.2.1.1**, **13.2.1.2** and **13.2.2.1** and which themselves fulfil the requirements of EN 60947-4-1 and EN 60947-5-1.

For printed circuit boards requirements as mentioned in **table H.1 (3.6)** are applicable.

13.3 Protection of motors and other electrical equipment

13.3.1 Motors directly connected to the mains shall be protected against short-circuiting.

13.3.2 (except as Motors directly connected to the mains shall be protected against overloads by means of manual reset provided for in **13.3.3**) automatic circuit-breakers which shall cut off the supply to the motor in all live conductors.

13.3.3 When the detection of overloads of the lift motor operates on the basis of increase of the temperature of the motor windings the interruption of the motor supply shall only occur in accordance with **13.3.6**.

13.3.4 The provisions of **13.3.2** and **13.3.3** apply to each winding if the motor has windings supplied by different circuits.

13.3.5 When the lift motors are supplied from D.C. generators driven by motors, the lift motors shall also be protected against overloads.

13.3.6 If the design temperature of an electrical equipment provided with a temperature monitoring device is exceeded and the lift should not continue in operation, then the car shall stop at a landing such as the passengers can leave the car. An automatic return to normal operation of the lift shall only occur after sufficient cooling down.

13.4 Main switches

13.4.1 Machine rooms shall contain, for each lift, a main switch capable of breaking the supply to the lift on all the live conductors. This switch shall be capable of interrupting the highest current involved in normal conditions of use of the lift.

This switch shall not cut the circuits feeding :

- a) car lighting or ventilation, if any ;
- b) socket outlet on the car roof ;
- c) lighting of machine and pulley rooms ;
- d) socket outlet in the machine room, in the pulley room and in the pit ;
- e) lighting of the lift well ;
- f) alarm device.

13.4.2 The main switches as defined in **13.4.1** shall have stable open and closed positions, and shall be capable of being locked-off in the open position, with the use of a padlock or equivalent, to ensure no inadvertent operation.

The control mechanism for the main switch shall be easily and rapidly accessible from the entrance(s) to the machine room. If the machine room is common to several lifts, the control mechanism of the main switches shall allow the lift concerned to be identified easily.

If the machine room has several points of access, or if the same lift has several machine rooms each with its own point(s) of access, a circuit breaker contactor may be used, release of which shall be controlled by an electric safety device, in conformity with **14.1.2**, inserted in the supply circuit to the coil of the circuit breaker contactor.

The re-engagement of the circuit breaker contactor shall not be carried out or made possible except by means of the device, which caused its release. The circuit-breaker contactor shall be used in conjunction with a manually controlled isolating switch.

13.4.3 In the case of a group of lifts, if, after the opening of the main switch for one lift, parts of the operating circuits remain live, these circuits shall be capable of being separately isolated in the machine room, if necessary by breaking the supply to all the lifts in the group.

13.4.4 Any capacitors to correct the power factor shall be connected before the main switch of the power circuit.

If there is a risk of over-voltage, when for example the motors are connected by very long cables, the switch of the power circuit shall also interrupt the connection to the capacitors.

13.5 Electric wiring

13.5.1 In the machine and pulley rooms and lift wells, the conductors and cables (with the exception of travelling cables) shall be selected from those standardized by CENELEC and of a quality at least equivalent to that defined by HD 21.3 S3 and HD 22.4 S3 taking into account the information given in **13.1.1.2**.

13.5.1.1 Conductors such as those in conformity with CENELEC HD 21.3 S3, parts 2 (H07V-U and H07V-R), 3 (H07V-K), 4 (H05V-U) and 5 (H05V-K) shall only be used provided they are installed in conduits (or trunking) made either of metal or plastics or the conductors are protected in an equivalent manner.

NOTE : These provisions replace those in the guide to use appearing in annex 1 of CENELEC HD 21.1 S3.

13.5.1.2 Rigid cables such as those in conformity with 2 of CENELEC HD 21.4 S2 shall only be used in visible mountings fixed to the walls of the well (or of the machine room) or installed in ducting, trunking or similar fittings.

13.5.1.3 Ordinary flexible cables such as those in conformity with 3 (H05RR-F) of CENELEC HD 22.4 S3 and 5 (H05VV-F) of CENELEC HD 21.5 S3, shall only be used in ducting, trunking or fittings ensuring equivalent protection.

Flexible cables with a thick sheath such as those in conformity with 5 (H07RN-F) of CENELEC HD 22.4 S3 may be used like rigid cables in the conditions defined in **13.5.1.2**, and for connection to a

movable appliance (except as travelling cables for connection to the car) or if they are subject to vibrations.

Travelling cables in conformity with EN 50214 and CENELEC HD 360 S2 shall be accepted as cables for connection to the car, within the limits laid down by these documents. In all cases, the travelling cables selected shall be of at least equivalent quality.

13.5.1.4 The requirements of **13.5.1.1**, **13.5.1.2** and **13.5.1.3** need not apply :

a) to conductors or cables not connected to electric safety devices on landing doors, provided that :

- 1) they are not subject to a rated output of more than 100 VA ;
- 2) the voltage, between poles (or phases) or between a pole (or one of the phases) and earth, to which they are normally subject does not exceed 50 V ;

b) to the wiring of operating or distribution devices in cabinets or on panels :

- 1) either between different pieces of electric equipment, or
- 2) between these pieces of equipment and the connection terminals.

13.5.2 Cross-sectional area of conductors

In order to provide mechanical strength the cross-sectional area of conductors to electric safety devices of doors shall not be less than 0,75 mm².

13.5.3 Method of installation

13.5.3.1 The electric installation shall be provided with the indications necessary to make it easy to understand.

13.5.3.2 Connections, connection terminals and connectors, except those defined in **13.1.2**, shall be located in cabinets, boxes or on panels provided for this purpose.

13.5.3.3 If, after the opening of the main switch or switches of a lift, some connection terminals remain live, they shall be clearly separated from terminals, which are not live, and if the voltage exceeds 50 V, they shall be suitably marked.

13.5.3.4 Connection terminals whose accidental interconnection could lead to a dangerous malfunction of the lift shall be clearly separated unless their method of construction obviates this risk.

13.5.3.5 In order to ensure continuity of mechanical protection, the protective sheathing of conductors and cables shall fully enter the casings of switches and appliances, or shall terminate in a suitably constructed gland.

NOTE : Enclosed frames of landing and car doors are regarded as appliance casings.

However, if there is a risk of mechanical damage due to movement of parts or sharp edges of the frame itself, the conductors connected to the electric safety device shall be protected mechanically.

13.5.3.6 If the same ducting or cable contain conductors whose circuits have different voltages, all the conductors or cables shall have the insulation specified for the highest voltage.

13.5.4 Connectors

Connectors and devices of the plug-in type placed in safety circuits shall be so designed and arranged that, if erroneous interconnection could lead to dangerous malfunction of the lift, or their withdrawal does not require the use of a tool, it is impossible to re-insert the plug incorrectly.

13.6 Lighting and socket outlets

13.6.1 The electric lighting supplies to the car, the well and the machine and pulley rooms, shall be independent of the supply to the machine, either through another circuit or through connection to the machine supply circuit on the supply side of the main switch or the main switches laid down in **13.4**.

13.6.2 The supply to socket outlets required on the car roof, in the machine and pulley rooms and in the pit, shall be taken from the circuits referred to in **13.6.1**.

These socket outlets are :

- a) either of type 2 P + PE, 250 V, supplied directly, or
- b) supplied at a safety extra-low voltage (SELV) in accordance with CENELEC HD 384.4.41 S2, subclause 411.

The use of the above socket outlets does not imply that the supply cable has a cross-sectional area corresponding to the rated current of the socket outlet. The cross-sectional area of the conductors may be smaller, provided that the conductors are correctly protected against excess currents.

13.6.3 Control of the supply for lighting and socket outlets

13.6.3.1 A switch shall control the supply to the circuit for lighting and socket outlets of the lift car. If the machine room contains several lift machines it is necessary to have one switch per car. This switch shall be located close to the corresponding main power switch.

13.6.3.2 In the machine room a switch or a similar device shall be located near to its access(es) controlling the supply for lighting.

For the well lighting switches (or equivalent) shall be located both at the machine room and pit so that the well light can be operated from either location.

13.6.3.3 Each circuit controlled by the switches laid down in **13.6.3.1** and **13.6.3.2** shall have its own short circuit protection.

14 Protection against electric faults ; controls ; priorities

14.1 Failure analysis and electric safety devices

14.1.1 Failure analysis

Any single fault listed in **14.1.1.1** in the electric equipment of a lift, if it cannot be excluded under conditions described in **14.1.1.2** and/or **annex H** shall not, on its own, be the cause of a dangerous malfunction of the lift.

For safety circuits, see **14.1.2.3**.

14.1.1.1 Faults envisaged :

- a) absence of voltage ;
- b) voltage drop ;
- c) loss of continuity of a conductor ;
- d) insulation fault in relation to the metalwork or the earth ;
- e) short circuit or open circuit, change of value or function in an electrical component such as for instance resistor, capacitor, transistor, lamp, etc. ;
- f) non-attraction or incomplete attraction of the moving armature of a contactor or relay ;
- g) non-separation of the moving armature of a contactor or relay ;
- h) non-opening of a contact ;
- i) non-closing of a contact ;
- j) phase reversal.

14.1.1.2 The non-opening of a contact need not be considered in the case of safety contacts conforming to the requirements of **14.1.2.2**.

14.1.1.3 The earthing to the metalwork or the earth of a circuit in which there is an electric safety device shall :

- a) either cause the immediate stopping of the machine, or
- b) prevent restarting of the machine after the first normal stop.

Return to service shall only be possible by manual resetting

14.1.2 Electric safety devices

14.1.2.1 General provisions

14.1.2.1.1 During operation of one of the electric safety devices required in several clauses, movement of the machine shall be prevented or it shall be caused to stop immediately as indicated in **14.1.2.4**. A list of such devices is given in **annex A**.

The electric safety devices shall consist of :

- a) either one or more safety contacts satisfying **14.1.2.2** directly cutting the supply to the contactors referred to in **12.7** or their relay-contactors ;
- b) or safety circuits satisfying **14.1.2.3**, consisting of one or a combination of the following :
 - 1) either one or more safety contacts satisfying **14.1.2.2** not directly cutting the supply to the contactors referred to in **12.7** or their relay-contactors ;
 - 2) contacts not satisfying the requirements of **14.1.2.2** ;
 - 3) components in accordance with **annex H**.

14.1.2.1.2 (Kept free).

14.1.2.1.3 Apart from exceptions permitted in this standard (see **14.2.1.2**, **14.2.1.4** and **14.2.1.5**), no electric equipment shall be connected in parallel with an electric safety device.

Connections to different points of the electric safety chain are only permitted for gathering information. The devices used for that purpose shall fulfil the requirements for safety circuits according to **14.1.2.3**.

14.1.2.1.4 The effects of internal or external induction or capacity shall not cause failure of electric safety devices.

14.1.2.1.5 An output signal emanating from an electric safety device shall not be altered by an extraneous signal emanating from another electric device placed further down the same circuit, which would cause a dangerous condition to result.

14.1.2.1.6 In safety circuits comprising two or more parallel channels, all information other than that required for parity checks shall be taken from one channel only.

14.1.2.1.7 Circuits which record or delay signals shall not, even in event of fault, prevent or appreciably delay the stopping of the machine through the functioning of an electric safety device, i. e. the stopping shall occur in the shortest time compatible with the system.

14.1.2.1.8 The construction and arrangement of the internal power supply units shall be such as to prevent the appearance of false signals at outputs of electric safety devices due to the effects of switching.

14.1.2.2 Safety contacts

14.1.2.2.1 The operation of a safety contact shall be by positive separation of the circuit-breaking devices. This separation shall occur even if the contacts have welded together.

The design of a safety contact shall be such as to minimize the risk of a short-circuit resulting from component failure.

NOTE : Positive opening is achieved when all the contact-breaking elements are brought to their open position and when for a significant part of the travel there are no resilient members (e.g. springs) between the moving contacts and the part of the actuator to which the actuating force is applied.

14.1.2.2.2 The safety contacts shall be provided for a rated insulation voltage of 250 V if the enclosure provides a degree of protection of at least IP 4X, or 500 V if the degree of protection of the enclosure is less than IP 4X.

The safety contacts shall belong to the following categories as defined in EN 60947-5-1 :

- a) AC-15 for safety contacts in A.C. circuits ;
- b) DC-13 for safety contacts in D.C. circuits.

14.1.2.2.3 If the degree of protection is equal or less than IP4X, the clearances shall be at least 3 mm, the creepage distances at least 4 mm and the distances for breaking contacts at least 4 mm after separation. If the protection is better than IP4X the creepage distance can be reduced to 3 mm.

14.1.2.2.4 In the case of multiple breaks, the distance after separation between the contacts shall be at least 2 mm.

14.1.2.2.5 Abrasion of conductive material shall not lead to short circuiting of contacts.

14.1.2.3 Safety circuits

14.1.2.3.1 Safety circuits shall comply with the requirements of **14.1.1** relative to the appearance of a fault.

14.1.2.3.2 Furthermore, as illustrated by **figure 6** the following requirements shall apply :

14.1.2.3.2.1 If one fault combined with a second fault can lead to a dangerous situation, the lift shall be stopped at the latest at the next operating sequence in which the first faulty element should participate.

All further operation of the lift shall be impossible as long as this fault persists.

The possibility of the second fault occurring after the first, and before the lift has been stopped by the sequence mentioned above, is not considered.

14.1.2.3.2.2 If two faults which by themselves do not lead to a dangerous situation, when combined with a third fault can lead to a dangerous situation, the lift shall be stopped at the latest at the next operating sequence in which one of the faulty elements should participate.

The possibility of the third fault leading to a dangerous situation before the lift has been stopped by the sequence mentioned above, is not considered.

14.1.2.3.2.3 If a combination of more than three faults is possible, then the safety circuit shall be designed with multiple channels and a monitoring circuit checking the equal status of the channels.

If a different status is detected the lift shall be stopped.

In case of two channels the function of the monitoring circuit shall be checked prior to a re-start of the lift at the latest, and in case of failure, re-starting shall not be possible.

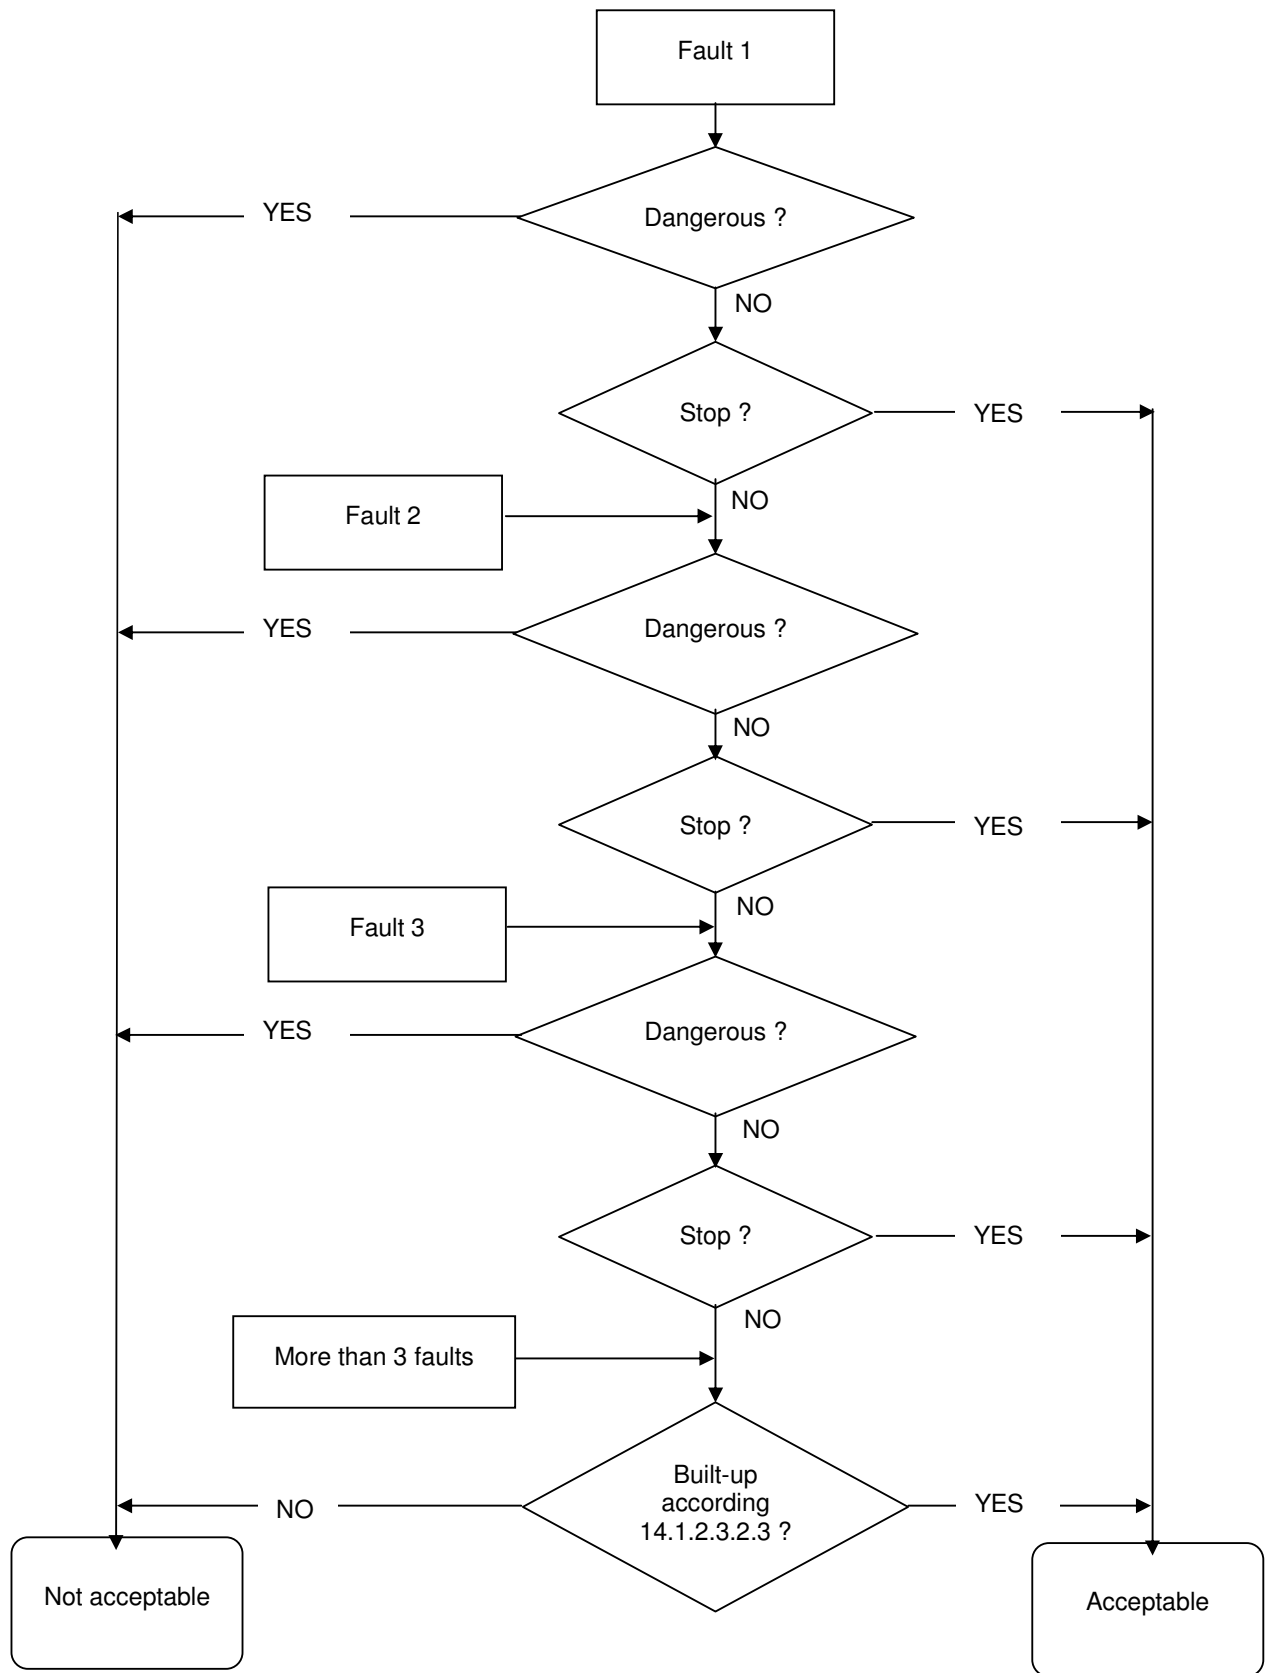


Figure 6 : Diagram for assessing safety circuits

14.1.2.3.2.4 On restoration of the power supply after it has been disconnected, maintenance of the lift in the stopped position is not necessary, provided that during the next sequence stopping is reimposed in the cases covered by **14.1.2.3.2.1** up to **14.1.2.3.2.3**.

14.1.2.3.2.5 In redundancy-type circuits measures shall be taken to limit as far as possible the risk of defects occurring simultaneously in more than one circuit arising from a single cause.

14.1.2.3.3 Safety circuits containing electronic components are regarded as safety components and shall be verified according to the requirements in **F.6**.

14.1.2.4 Operation of electric safety devices

When operating to ensure safety, an electric safety device shall prevent the setting in motion of the machine or initiate immediately its stopping. The electric supply to the brake shall likewise be broken.

The electric safety devices shall act directly on the equipment controlling the supply to the machine in accordance with the requirements of **12.7**.

If, because of the power to be transmitted, relay contactors are used to control the machine, these shall be considered as equipment directly controlling the supply to the machine for starting and stopping.

14.1.2.5 Actuation of electric safety devices

The components actuating the electric safety devices shall be built so that they are able to function properly under the mechanical stresses resulting from continuous normal operation.

If the devices for actuating electric safety devices are through the nature of their installation accessible to persons, they shall be so built that these electric safety devices cannot be rendered inoperative by simple means.

NOTE : A magnet or a bridge piece is not considered a simple means.

In the case of redundancy-type safety circuits, it shall be ensured by mechanical or geometric arrangements of the transmitter elements that a mechanical fault shall not cause loss of redundancy.

For transmitter elements of safety circuits, the requirements of **F.6.3.1.1** apply.

14.2 Controls

14.2.1 Control of lift operations

Control shall be effected electrically.

14.2.1.1 Control of normal operation

This control shall be by the aid of buttons or similar devices, such as touch control, magnetic cards, etc. These shall be placed in boxes, such that no live parts are accessible to the user.

14.2.1.2 Control of levelling and re-levelling with doors open

In the specific case referred to in **7.7.2.2 a)** movement of the car with landing and car doors open is permitted for levelling and re-levelling on condition that :

a) the movement is limited to the unlocking zone (**7.7.1**) :

1) all movement of the car outside the unlocking zone shall be prevented by at least one switching device mounted in the bridge or shunt of the door and lock electric safety devices ;

2) this switching device shall :

- either be a safety contact in conformity with **14.1.2.2**, or

- be connected in such a way as to satisfy the requirements for safety circuits in **14.1.2.3** ;

3) if the operation of the switches is dependent upon a device which is indirectly mechanically linked to the car, e.g. by rope, belt or chain, the breaking of or slack in the connecting link shall cause the machine to stop through the action of an electric safety device in conformity with **14.1.2** ;

4) during levelling operations, the means for making the electric safety devices of doors inoperative shall only function after the stopping signal for this landing has been given ;

b) the speed of levelling does not exceed 0,8 m/s. In addition on lifts with manually controlled landing doors, there shall be a check that :

1) for machines whose maximum speed of rotation is determined by the fixed frequency of the supply, the control circuit for the low speed movement only has been energized ;

2) for other machines, the speed at the moment the unlocking zone is reached does not exceed 0,8 m/s ;

c) the speed of re-levelling does not exceed 0,3 m/s. It shall be checked :

1) for machines whose maximum speed of rotation is determined by the fixed frequency of the supply, that the control circuit for the low speed movement only has been energized ;

2) for machines supplied from static converters, that re-levelling speed does not exceed 0,3 m/s.

14.2.1.3 Control of inspection operation

To facilitate inspection and maintenance, a readily accessible control station shall be provided on the car roof. This device shall be brought into operation by a switch (inspection operation switch) which shall satisfy the requirements for electric safety devices (**14.1.2**).

This switch, which shall be bi-stable, shall be protected against involuntary operation.

The following conditions shall be satisfied simultaneously :

a) engagement of the inspection operation shall neutralize :

- 1) the normal operation controls, including the operation of any automatic power operated doors ;
- 2) emergency electrical operation (**14.2.1.4**) ;
- 3) docking operation (**14.2.1.5**).

The return to normal service of the lift shall only be effected by another operation of the inspection switch.

If the switching devices used for this neutralization are not safety contacts integral with the inspection switch mechanism, precautions shall be taken to prevent all involuntary movement of the car in the event of one of the faults listed in **14.1.1.1** appearing in the circuit ;

- b) the movement of the car shall be dependent on a constant pressure on a push-button protected against accidental operation and with the direction of movement clearly indicated ;
- c) the control device shall also incorporate a stopping device in conformity with **14.2.2** ;
- d) the car speed shall not exceed 0,63 m/s ;
- e) the limits of normal car travel shall not be overrun ;
- f) the operation of the lift shall remain dependent on the safety devices.

The control station may also incorporate special switches protected against accidental operation for controlling the mechanism of doors from the car roof.

14.2.1.4 Control of emergency electrical operation

For machines where the manual effort to raise the car with its rated load exceeds 400 N an emergency electrical operation switch in conformity with **14.1.2** shall be installed in the machine room. The machine shall be supplied from the normal mains supply or from the standby supply if there is one.

The following conditions shall be satisfied simultaneously :

- a) operation of the emergency electrical operation switch shall permit, from the machine room, the control of car movement by constant pressure on buttons protected against accidental operation. The direction of movement shall be clearly indicated ;
- b) after operation of the emergency electrical operation switch, all movement of the car except that controlled by this switch shall be prevented.

The effects of the emergency electrical operation shall be overridden by switching on the inspection operation ;

- c) the emergency electrical operation switch shall render inoperative by itself or through another electric switch in conformity with **14.1.2** the following electric devices :

- 1) those mounted on the safety gear, according to **9.8.8** ;
 - 2) those of the overspeed governor, according to **9.9.11.1** and **9.9.11.2** ;
 - 3) those mounted on the ascending car overspeed protection means, according to **9.10.5** ;
 - 4) final limit switches, according to **10.5** ;
 - 5) those mounted on the buffers, according to **10.4.3.4** ;
- d) the emergency electrical operation switch and its push-buttons shall be so placed that the machine can readily be observed when using them ;
 - e) the car speed shall not exceed 0,63 m/s.

14.2.1.5 Control of docking operation

In the specific case covered by **7.7.2.2 b)**, movement of the car is permitted with the landing and car doors open to allow loading or unloading of lifts, under the following conditions :

- a) movement of the car shall only be possible in a zone not exceeding 1,65 m above the corresponding landing level ;
- b) movement of the car shall be limited by a directional electric safety device in conformity with the requirements of **14.1.2** ;
- c) the speed shall not exceed 0,3 m/s ;
- d) the landing door and the car door shall only be opened on the docking side ;
- e) the zone of movement shall be clearly visible from the docking operation control position ;
- f) the docking operation shall only become possible after operation of a key operated safety contact, the key of which can only be removed when in position to discontinue the docking operation. A key of this type shall be given only to a responsible person together with a written instruction drawing attention to the danger which may be involved in using this key ;
- g) the engagement of the key operated safety contact :

1) shall neutralize the effects of the normal operation controls.

If the switching devices used are not safety contacts integral with the key operated contact mechanisms, precautions shall be taken to prevent all involuntary movement of the car in the event of one of the faults listed in **14.1.1.1** appearing in the circuit ;

2) shall only allow movement of the car by use of a constant pressure button. The direction of movement shall be clearly indicated ;

3) may render inoperative, by itself or through another electric switch in conformity with **14.1.2** :

- the electric safety device of the lock of the landing door concerned ;
- the electric safety device for proving closure of the landing door concerned ;
- the electric safety device for proving closure of the car door at the docking entrance ;

h) the effects of the docking operation shall be overridden by the engagement of the inspection operation ;

i) there shall be a stopping device in the car (**14.2.2.1 e**).

14.2.2 Stopping devices

14.2.2.1 A stopping device shall be provided for stopping, and maintaining the lift out of service, including the power operated doors :

a) in the lift pit (**5.7.3.4 a**) ;

b) in the pulley room (**6.4.5**) ;

c) on the car roof (**8.15**), in an easily accessible position and no more than 1 m from the entry point for inspection or maintenance personnel. This device may be the one located next to the inspection operation control if this is not placed more than 1 m from the access point;

d) at the inspection control device (**14.2.1.3 c**) ;

e) in the car of lifts with docking operation (**14.2.1.5 i**).

The stopping device shall be placed within 1 m of the entrance with docking operation and be clearly identified (**15.2.3.1**).

14.2.2.2 The stopping devices shall consist of electric safety devices in conformity with **14.1.2**. They shall be bi-stable and such that a return to service cannot result from an involuntary action.

14.2.2.3 A stopping device in the car shall not be used except for cars with docking operation.

14.2.3 Emergency alarm device

14.2.3.1 In order to call for outside assistance, passengers shall have available in the car an easily recognizable and accessible device for this purpose.

14.2.3.2 The power for this device shall be either from the emergency lighting supply called for in **8.17.4** or from an equivalent supply.

NOTE : In the case of connection to a public telephone network, **14.2.3.2** does not apply.

14.2.3.3 This device shall allow a two-way voice communication allowing permanent contact with a rescue service. After initiation of the communication system no further action of the trapped person shall be necessary.

14.2.3.4 An intercom system, or similar device, powered by the emergency supply referred to in **8.17.4**, shall be installed between inside the car and the machine room if the lift travel exceeds 30 m.

14.2.4 Priorities and signals

14.2.4.1 For lifts with manual doors, a device shall prevent the car leaving a landing for a period of at least 2 s after stopping.

14.2.4.2 A user entering the car shall have at least 2 seconds after the doors have closed, to actuate a control device before any external call buttons can become effective.

This requirement need not apply in the case of lifts operating on collective control.

14.2.4.3 In the case of collective control, an illuminated signal, which is clearly visible from the landing, shall indicate to the users waiting on this landing the direction of the next movement imposed on the car.

NOTE : For groups of lifts, position indicators on the landings are not recommended. However, it is recommended that the arrival of a car be preceded by an audible signal.

14.2.5 Load control

14.2.5.1 The lift shall be fitted with a device to prevent normal starting, including re-levelling, in the event of overload in the car.

14.2.5.2 The overload is considered to occur when the rated load is exceeded by 10 % with a minimum of 75 kg.

14.2.5.3 In the event of overload :

- a) users shall be informed by an audible and/or a visible signal in the car ;
- b) automatic power operated doors shall be brought into the fully open position ;
- c) manually operated doors shall remain unlocked ;
- d) any preliminary operation in accordance with **7.7.2.1** and **7.7.3.1** shall be nullified.

15 Notices, markings and operating instructions

15.1 General provisions

All labels, notices, markings and operating instructions shall be indelible, legible and readily understandable (if necessary aided by signs or symbols). They shall be untearable, of durable material, placed in a visible position, and written in the language of the country where the lift is installed (or, if necessary, in several languages).

15.2 Car

15.2.1 In the car the rated load of the lift in kilogrammes as well as the number of persons shall be displayed.

The number of persons shall be determined by reference to **8.2.3**.

The notice shall be made as follows :

“... kg ... PERS.”

The minimum height of the characters used for the notice shall be :

- a) 10 mm for capital letters and numbers ;
- b) 7 mm for small letters.

15.2.2 The vendor's name and the vendor's lift identification number shall be displayed in the car.

15.2.3 Other information in the car

15.2.3.1 The control device of the stop switch (where fitted) shall be red in colour and identified by the word **“STOP”**, so placed that there can be no risk of error as to the stop position.

The button (if any) of the alarm switch shall be yellow in colour and identified by the symbol :



The colours red and yellow shall not be used for other buttons. However, these colours may be used for illuminated 'call registered' signals.

15.2.3.2 The control devices shall be clearly identified by reference to their function ; for this purpose it is recommended to use :

- a) for control buttons the markings -2, -1, 0, 1, 2, 3, etc. ;
- b) for the door re-open button, where applicable, the indication :



15.2.4 Instructions to ensure safe usage of the lift shall be placed in the car whenever the need for these is apparent.

These shall at least indicate :

- a) in the case of a lift with docking operation, instructions specific to this operation ;
- b) for lifts with telephones or intercom system, the instructions for use, if not self-evident ;
- c) that after using the lift, it is necessary to close manually operated doors and power operated doors where closing is carried out under the continuous control of the users.

15.3 Car roof

On the car roof the following information shall be given :

- a) the word “**STOP**” on or near the stopping device(s), so placed that there can be no risk of error as to the stop position ;
- b) the words “**NORMAL**” and “**INSPECTION**” on or near the inspection operation switch ;
- c) the direction of motion on or near the inspection buttons ;
- d) warning sign or a notice at the balustrade.

15.4 Machine and pulley rooms

15.4.1 A notice bearing the following minimum inscription :

**“Lift Machine - Danger
Access forbidden to unauthorized persons”**

shall be fixed to the outside of doors or trap-doors giving access to the machines and pulleys.

In the case of trap-doors, a permanently visible notice shall indicate to those using the trap-door :

“Danger of falling - Reclose the trap-door”

15.4.2 Notices shall be provided to permit easy identification of the main switch(es) and the light switch(es).

If, after release of a main switch, some parts remain live (interconnection between lifts, lighting, ...) notice (s) shall indicate this.

15.4.3 In the machine room , there shall be detailed instructions to be followed in the event of lift breakdown, particularly concerning the use of the device for manual or electrical emergency movement, and the unlocking key for landing doors.

15.4.3.1 The direction of movement of the car shall be clearly indicated on the machine, close to the hand winding wheel.

If the wheel is not removable, the indication may be on the wheel itself.

15.4.3.2 On or near the emergency electrical operation buttons, there shall be markings to show the corresponding direction of movement.

15.4.4 On or near the stopping device in the pulley room there shall be the word “**STOP**” so placed that there can be no risk of error as to the stop position.

15.4.5 The maximum permissible load shall be indicated on the lifting beam or hooks (see **6.3.7**).

15.5 Well

15.5.1 Outside the well, near the inspection doors, there shall be a notice stating :

**“Lift well - Danger
Access forbidden to unauthorized persons”**

15.5.2 Landing doors with manual opening, if they can be confused with other adjacent doors, shall bear the inscription “**LIFT**”.

15.5.3 On goods passenger lifts a sign, which is visible from the landing loading area at all times, shall display the rated load.

15.6 Overspeed governor

On the overspeed governor a data plate shall be fixed indicating :

- a) the name of the manufacturer of the overspeed governor ;
- b) the type examination sign and its references ;
- c) the actual tripping speed for which it has been adjusted.

15.7 Pit

On or near the stop switch in the pit there shall be the word “**STOP**”, so placed that there can be no risk of error as to the stop position.

15.8 Buffers

On the buffers, other than energy accumulation type buffers, there shall be a data plate showing :

- a) the name of the manufacturer of the buffer ;
- b) the type examination sign and its references.

15.9 Landing identification

Visible notices or signals shall permit persons in the car to know at which landing the lift has stopped.

15.10 Electrical identification

Contactors, relays, fuses and connection strips for circuits coming into the control panels shall be marked in accordance with the wiring diagram. The necessary fuse specifications such as value and type shall be marked on the fuse or on or near the fuse holders.

In the case of the use of multiple wire connectors, only the connector, and not the wires, needs to be marked.

15.11 Unlocking key for landing doors

The unlocking key shall have a label attached drawing attention to the danger which may be involved in using this key and the need to make sure that the door is locked after it has been closed.

15.12 Alarm device

The bell or device activated during a call for help from the car shall be clearly marked “**Lift alarm**”.

In the case of multiple lifts it shall be possible to identify the car from which the call is being made.

15.13 Locking devices

On locking devices a data plate shall be fixed indicating :

- a) the name of the manufacturer of the locking device ;

- b) the type examination sign and its references.

15.14 Safety gear

On safety gears a data plate shall be fixed indicating :

- a) the name of the manufacturer of the safety gear ;
- b) the type examination sign and its references.

15.15 Groups of lifts

If parts of different lifts are present in one machine-, and/or pulley room each lift shall be identified with a number or letter consistently used for all parts (machine, controller, overspeed governor, switches, etc.).

To facilitate maintenance, etc. on the car roof, in the pit or other places where necessary, the same identification symbol shall appear.

15.16 Ascending car overspeed protection means

On the ascending car overspeed protection means a data plate shall be fixed indicating :

- a) the name of the manufacturer ;
- b) the type examination sign and its reference ;
- c) the actual tripping speed for which it has been adjusted.

16 Examinations - Tests - Register - Maintenance

16.1 Examinations and tests

16.1.1 The technical dossier to be supplied if applying for preliminary authorization shall contain the necessary information to ascertain that the constituent parts are correctly designed and the proposed installation is in conformity with this standard.

This verification can only relate to items, or some of them, which form the subject of an examination or test prior to putting the lift into service.

NOTE : **Annex C** might serve as a basis for those who wish to carry out, or to have carried out, a study of an installation before putting it into effect.

16.1.2 Before putting into service, lifts shall be subject of examinations and tests in accordance with **annex D**.

NOTE : It may be required in the case of lifts which have not been subject to application for a preliminary authorization, to supply all or some of the technical information and calculations which appear in **annex C**.

16.1.3 A copy of each relevant type examination certificate shall be provided for :

- a) locking devices ;
- b) landing doors (i.e. fire test certificate) ;
- c) safety gear ;
- d) overspeed governors ;
- d) ascending car overspeed protection means ;
- f) energy dissipation type buffers, energy accumulation type buffers with buffered return movement and energy accumulation type buffers with non linear characteristics ;
- g) safety circuits containing electronic components.

16.2 Register

The basic characteristics of the lift shall be recorded in a register, or file, drawn up at the latest at the time the installation is put into service. This register or file shall comprise :

- a) a technical section giving :
 - 1) the date the lift was put into service ;
 - 2) the basic characteristics of the lift ;
 - 3) the characteristics of the ropes and/or chains ;
 - 4) the characteristics of those parts for which verification of conformity is required (**16.1.3**) ;
 - 5) the plans of installation in the building ;
 - 6) electric schematic diagrams (using CENELEC symbols) ;
the circuit diagrams may be limited to the circuits for the overall understanding of the safety considerations. The abbreviations used with the symbols shall be explained by means of a nomenclature ;
- b) a section intended to keep duplicate dated copies of examination and inspection reports, with observations.

This register or file shall be kept up-to-date in case of :

- 1) important modifications to the lift (**annex E**) ;
- 2) replacement of ropes or important parts ;
- 3) accidents.

NOTE : This register or file should be available to those in charge of the maintenance, and to the person or organization responsible for the periodical examinations and tests.

16.3 Installer information

The manufacturer/installer shall provide an instruction manual.

16.3.1 Normal use

The instruction manual shall give the necessary information about the normal use of the lift and rescue operation, especially about :

- a) keeping the machine room door locked ;
- b) safe loading and unloading ;
- c) precaution to be taken in case of lifts with partially enclosed well (**5.2.1.2 d**) ;
- d) events needing the intervention of a competent person ;
- e) keeping the documentation ;
- f) the use of the emergency unlocking key ;
- g) rescue operation.

16.3.2 Maintenance

The instruction manual shall inform about :

- a) necessary maintenance of the lift and its accessories in order to keep it in working order (see **0.3.2**) ;
- b) instruction for safe maintenance.

16.3.3 Examinations and tests

The instruction manual shall inform about the following :

16.3.3.1 Periodical examinations

Periodical examinations and tests on lifts should be carried out after they are put into service to verify that they are in good condition. These periodical examinations and tests should be carried out in accordance with **annex E**.

16.3.3.2 Examinations after important modifications or accidents

Examinations and tests should be carried out after important modifications or after an accident to ascertain that lifts continue to conform to this standard. These examinations and tests should be carried out in accordance with **annex E**.